



# Air Conditioning Technical Data

Condensing units for air handling applications (pair)



EEEN15-205

ERQ-AW1



# TABLE OF CONTENTS

## ERQ-AW1

1	Features .....	2
2	Specifications .....	3
	Technical Specifications .....	3
	Electrical Specifications .....	4
3	Options .....	6
4	Combination table .....	7
5	Capacity tables .....	8
	Cooling Capacity Tables .....	8
	Heating Capacity Tables .....	14
	Integrated Heating Capacity Correction Factor .....	20
	Capacity Correction Factor .....	21
6	Dimensional drawings .....	22
	Dimensional Drawings .....	22
	Dimensional Drawings with Accessories .....	23
7	Centre of gravity .....	24
8	Piping diagrams .....	26
9	Wiring diagrams .....	29
	Wiring Diagrams - Single Phase .....	29
10	External connection diagrams .....	32
11	Sound data .....	33
	Sound Power Spectrum .....	33
	Sound Pressure Spectrum .....	34
12	Installation .....	35
	Installation Method .....	35
	Fixation and Foundation of Units .....	36
13	Operation range .....	37

# 1 Features

- Wide range of units offers maximum application potential and flexible control options
- Connect ERQ to a Biddle air curtain for a reliable and effective method of separating outdoor and indoor climates, offering a payback period of less than 1.5 years compared to electric air curtains
- Connect ERQ to an air handling unit to provide optimized air conditions such as fresh air and humidity control, both in heating and cooling, for small warehouses, showrooms and offices
- Control box and expansion valve kit are required for each combination plus an air handling unit

1



2

## 2 Specifications

2-1 Technical Specifications					ERQ125AW1		ERQ200AW1		ERQ250AW1	
Capacity range				HP	5		8		10	
Cooling capacity	Nom.			kW	14.0 (1)		22.4 (1)		28.0 (1)	
Heating capacity	Nom.			kW	16.0 (2)		25.0 (2)		31.5 (2)	
Power input	Cooling	Nom.		kW	3.52 (1)		5.22 (1)		7.42 (1)	
	Heating	Nom.		kW	4.00 (2)		5.56 (2)		7.70 (2)	
Capacity control	Method				Inverter controlled					
	Cooling	Max.		%	100					
EER					3.98 (1)		4.29 (1)		3.77 (1)	
COP					4.00 (2)		4.50 (2)		4.09 (2)	
Dimensions	Unit	Height	mm		1,680					
		Width	mm		635		930			
		Depth	mm		765					
	Packed unit	Height	mm		1,855					
		Width	mm		796		1,055			
		Depth	mm		860					
Weight	Unit			kg	159		187		240	
	Packed unit			kg	182		217		273	
Packing	Material				Carton					
	Weight			kg	3.8		4.02			
Packing 2	Material				Wood					
	Weight			kg	19.15		20.85			
Packing 3	Material				Plastic					
	Weight			kg	0.215		0.265			
Casing	Colour				Daikin White					
	Material				Painted galvanized steel plate					
Heat exchanger	Length			mm	1,483		1,778			
	Rows	Quantity			54					
	Fin pitch			mm	2					
	Passes	Quantity			8		18			
	Face area			m²	1.762		2.112			
	Stages	Quantity			2					
	Empty tubeplate hole	Quantity			0					
	Tube type				ø8 Hi-XSS					
	Fin	Type			Non-symmetric waffle louver					
		Treatment			Hydrophilic and corrosion resistant					
Compressor	Quantity				1				2	
	Model				Inverter					
	Type				Hermetically sealed scroll compressor					
	Speed			rpm	6,300		7,980		6,300	
	Output			W	2,800		3,800		1,200	
	Crankcase heater			W	33					
Compressor 2	Model				-				ON - OFF	
	Type				-				Hermetically sealed scroll compressor	
	Speed			rpm	-				2,900	
	Output			W	-				4,500	
	Crankcase heater			W	-				33	
Fan	Type				Propeller fan					
	Discharge direction				Vertical					
	Quantity				1					
	Air flow rate	Cooling	Nom.	m³/min	95		171		185	
		Heating	Nom.	m³/min	95		171		185	
	External static pressure	Max.			Pa	78				
Fan motor	Quantity				1					
	Model				Brushless DC motor					
	Output			W	350.00		750.00			
Sound power level	Nom.			dBA	72		78			

## 2 Specifications

2-1 Technical Specifications					ERQ125AW1	ERQ200AW1	ERQ250AW1
Sound pressure level	Nom.			dBA	54	57	58
Operation range	Cooling	Min.		°CDB	-5		
		Max.		°CDB	43		
	Heating	Min.		°CWB	-20		
		Max.		°CWB	15		
	On coil temperature	Heating	Min.	°CDB	10		
		Cooling	Max.	°CDB	35		
Refrigerant	Type				R-410A		
	Charge			kg	6.2	7.7	8.4
	Control				Electronic expansion valve		
	Circuits	Quantity			1		
Refrigerant oil	Type				Synthetic (ether) oil		
	Charged volume			l	1.7	2.1	4.3
Piping connections	Liquid	Type			Braze connection		
		OD		mm	9.52		
	Gas	Type			Braze connection		
		OD		mm	15.9	19.1	22.2
	Piping length	OU - IU	Max.	m	55		
	Heat insulation				Both liquid and gas pipes		
Defrost method					Reversed cycle		
Defrost control					Sensor for outdoor heat exchanger temperature		
Safety devices	Item	01			High pressure switch		
		02			Fan motor driver overload protector		
		03			Overcurrent relay		
		04			Inverter overload protector		
		05			PC board fuse		
PED	Category				Category II		

Standard Accessories : Operation manual; Quantity : 1;

Standard Accessories : Connection pipes; Quantity : 4;

Standard Accessories : Installation manual; Quantity : 1;

2-2 Electrical Specifications				ERQ125AW1	ERQ200AW1	ERQ250AW1
Power supply	Name			W1		
	Phase			3N~		
	Frequency		Hz	50		
	Voltage		V	400		
	Voltage range	Min.	%	-10		
		Max.	%	10		
Current	Nominal running current (RLA)	Cooling	A	5.1	7.5	11.3
		Heating	A	5.8	8.2	11.1
	Starting current	Cooling	A	-		74 (1)
	Zmax	Text		-	0.27	
	Minimum circuit amps (MCA)		A	11.9	18.5	21.6
	Maximum fuse amps (MFA)		A	16	25	
	Total overcurrent amps (TOCA)		A	15.6	16.5	31.5
	Full load amps (FLA)	Fan motor	A	0.4	0.7	0.9
	Minimum Ssc value			kVa	-	910
Wiring connections	For power supply	Quantity		5		
		Remark		Earth wire included		
	For connection with indoor	Quantity		2		
		Remark		F1,F2		
Power supply intake				Both indoor and outdoor unit		

## 2 Specifications

### Notes

(1) Cooling: indoor temp. 27°CDB, 19.0°CWB; outdoor temp. 35°CDB; equivalent piping length: 5m; level difference: 0m

(2) Heating: indoor temp. 20°CDB; outdoor temp. 7°CDB, 6°CWB; equivalent refrigerant piping: 5m; level difference: 0m

Sound values are measured in a semi-anechoic room.

Sound power level is an absolute value that a sound source generates.

Sound pressure level is a relative value, depending on the distance and acoustic environment. For more details, please refer to the sound level drawings.

MFA is used to select the circuit breaker and the ground fault circuit interrupter (earth leakage circuit breaker).

Maximum allowable voltage range variation between phases is 2%.

RLA is based on following conditions: indoor temp. 27°CDB, 19°CWB; outdoor temp. 35°CDB

Select wire size based on the value of MCA

TOCA means the total value of each OC set.

Voltage range: units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.

FLA means the full load amps of the fan motor.

In accordance with EN/IEC 61000-3-11, respectively EN/IEC 61000-3-12, it may be necessary to consult the distribution network operator to ensure that the equipment is connected only to a supply with  $Z_{sys} \leq Z_{max}$ , respectively  $S_{sc} \geq$  minimum  $S_{sc}$  value.

EN/IEC 61000-3-11: European/international technical standard setting the limits for voltage changes, voltage fluctuations and flicker in public low-voltage supply systems for equipment with rated  $\leq 75A$

EN/IEC 61000-3-12: European/international technical standard setting the limits for harmonic currents produced by equipment connected to public low-voltage system with input current  $> 16A$  and  $\leq 75A$  per phase

Short-circuit power

system impedance

MSC means the maximum current during start up of the compressor

### 3 Options

#### 3 - 1 Options

3

##### ERQ-AW1

N°	Item	ERQ125A7W1B	ERQ200A7W1B ERQ250A7W1B
1	Cool/heat selector	KRC19-26A6	
2	One option per module is required	KJB111A	
3	Central drain pan kit	KWC26B160	KWC26B280

4TW32031-4

##### Notes:

1. All options are kits.
2. Only 1 option per installation is needed.
3. One option per module is required
4. The option should be installed inside the outdoor unit.



## 4 Combination table

### 4 - 1 Combination Table

#### ERQ-AW1

Combination table

		Control box		Expansion valve kit						
Outdoor unit		EKEQDCBV3	EKEQFCBV3	EKEXV63	EKEXV80	EKEXV100	EKEXV125	EKEXV140	EKEXV200	EKEXV250
1 ph	ERQ100	P	P	P	P	P	P	-	-	-
	ERQ125	P	P	P	P	P	P	P	-	-
	ERQ140	P	P	-	P	P	P	P	-	-
3 ph	ERQ125	P	P	P	P	P	P	P	-	-
	ERQ200	P	P	-	-	P	P	P	P	P
	ERQ250	P	P	-	-	-	P	P	P	P

Heat pump

P: Pair: Combination depending on AHU heat exchanger volume and capacity

EKEXV Class	Allowed heat exchanger volume (dm <sup>3</sup> )		Allowed heat exchanger capacity (kW)	
	Minimum	Maximum	Minimum	Maximum
63	1.66	2.08	6.3	7.8
80	2.09	2.64	7.9	9.9
100	2.65	3.3	10	12.3
125	3.31	4.12	12.4	15.4
140	4.13	4.62	15.5	17.6
200	4.63	6.6	17.7	24.6
250	6.61	8.25	24.7	30.8

Saturated suction temperature (SST) = 6°C, Superheat (SH) = 5K

Air temperature = 27°CDB/19°CWB

If conflicting result occurs, capacity selection has priority over volume.

3TW32009-1

# 5 Capacity tables

## 5 - 1 Cooling Capacity Tables

### ERQ125AW1

#### Cooling

TC: Total capacity; kW; PI: Power Input; kW (Comp. + Outdoor fan motor)

Combination % kW (Capacity index)	Outdoor air temp. (°CDB)	Indoor air temp. °CWB															
		14.0 °CWB		16.0 °CWB		18.0 °CWB		19.0 °CWB		20.0 °CWB		22.0 °CWB		24.0 °CWB			
		20.0 °CDB		23.0 °CDB		26.0 °CDB		27.0 °CDB		28.0 °CDB		30.0 °CDB		32.0 °CDB			
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
100% 14.00 kW (125)	10	9.45	1.21	11.3	1.47	13.1	1.74	14.0	1.88	14.9	2.02	16.7	2.31	17.7	2.39		
	12	9.45	1.23	11.3	1.50	13.1	1.78	14.0	1.92	14.9	2.06	16.7	2.36	17.5	2.38		
	14	9.45	1.26	11.3	1.53	13.1	1.81	14.0	1.95	14.9	2.10	16.7	2.40	17.2	2.37		
	16	9.45	1.28	11.3	1.55	13.1	1.84	14.0	1.99	14.9	2.14	16.7	2.43	17.0	2.41		
	18	9.45	1.30	11.3	1.58	13.1	1.88	14.0	2.03	14.9	2.19	16.4	2.51	16.8	2.53		
	20	9.45	1.33	11.3	1.62	13.1	1.94	14.0	2.13	14.9	2.34	16.2	2.64	16.6	2.66		
	21	9.45	1.34	11.3	1.63	13.1	2.01	14.0	2.21	14.9	2.43	16.1	2.70	16.4	2.72		
	23	9.45	1.38	11.3	1.74	13.1	2.15	14.0	2.37	14.9	2.60	15.9	2.82	16.2	2.84		
	25	9.45	1.47	11.3	1.86	13.1	2.30	14.0	2.54	14.9	2.79	15.6	2.94	16.0	2.97		
	27	9.45	1.56	11.3	1.98	13.1	2.46	14.0	2.71	14.9	2.98	15.4	3.07	15.8	3.09		
	29	9.45	1.67	11.3	2.12	13.1	2.62	14.0	2.90	14.9	3.16	15.2	3.19	15.5	3.22		
	31	9.45	1.77	11.3	2.26	13.1	2.80	14.0	3.09	14.6	3.29	15.0	3.32	15.3	3.34		
	33	9.45	1.89	11.3	2.40	13.1	2.99	14.0	3.30	14.4	3.41	14.7	3.44	15.1	3.47		
	35	9.45	2.00	11.3	2.56	13.1	3.18	14.0	3.52	14.2	3.54	14.5	3.57	14.9	3.60		
	37	9.45	2.13	11.3	2.72	13.1	3.39	13.8	3.64	13.9	3.66	14.3	3.69	14.6	3.73		
	39	9.45	2.26	11.3	2.90	13.1	3.61	13.5	3.77	13.7	3.79	14.1	3.82	14.4	3.85		
90% 12.60 kW (113)	10	8.50	1.09	10.1	1.31	11.8	1.55	12.6	1.67	13.4	1.79	15.1	2.05	16.7	2.31		
	12	8.50	1.10	10.1	1.33	11.8	1.57	12.6	1.70	13.4	1.83	15.1	2.09	16.7	2.35		
	14	8.50	1.12	10.1	1.36	11.8	1.60	12.6	1.73	13.4	1.86	15.1	2.13	16.7	2.40		
	16	8.50	1.14	10.1	1.38	11.8	1.63	12.6	1.76	13.4	1.90	15.1	2.17	16.7	2.44		
	18	8.50	1.16	10.1	1.41	11.8	1.67	12.6	1.80	13.4	1.94	15.1	2.21	16.4	2.51		
	20	8.50	1.18	10.1	1.44	11.8	1.70	12.6	1.84	13.4	2.01	15.1	2.38	16.2	2.63		
	21	8.50	1.20	10.1	1.45	11.8	1.73	12.6	1.90	13.4	2.08	15.1	2.46	16.1	2.70		
	23	8.50	1.22	10.1	1.51	11.8	1.85	12.6	2.03	13.4	2.23	15.1	2.64	15.9	2.82		
	25	8.50	1.28	10.1	1.61	11.8	1.98	12.6	2.18	13.4	2.38	15.1	2.83	15.6	2.94		
	27	8.50	1.37	10.1	1.72	11.8	2.11	12.6	2.32	13.4	2.55	15.1	3.03	15.4	3.07		
	29	8.50	1.45	10.1	1.83	11.8	2.25	12.6	2.48	13.4	2.72	14.9	3.17	15.2	3.19		
	31	8.50	1.55	10.1	1.95	11.8	2.40	12.6	2.65	13.4	2.90	14.7	3.29	15.0	3.31		
	33	8.50	1.64	10.1	2.07	11.8	2.56	12.6	2.82	13.4	3.10	14.4	3.41	14.7	3.44		
	35	8.50	1.74	10.1	2.21	11.8	2.73	12.6	3.01	13.4	3.30	14.2	3.54	14.5	3.57		
	37	8.50	1.85	10.1	2.35	11.8	2.90	12.6	3.20	13.4	3.52	14.0	3.66	14.3	3.69		
	39	8.50	1.96	10.1	2.49	11.8	3.09	12.6	3.41	13.4	3.75	13.7	3.79	14.0	3.82		
80% 11.20 kW (100)	10	7.56	0.96	9.02	1.15	10.5	1.36	11.2	1.46	11.9	1.57	13.4	1.79	14.8	2.01		
	12	7.56	0.98	9.02	1.17	10.5	1.38	11.2	1.49	11.9	1.60	13.4	1.82	14.8	2.05		
	14	7.56	1.00	9.02	1.19	10.5	1.41	11.2	1.51	11.9	1.63	13.4	1.86	14.8	2.09		
	16	7.56	1.01	9.02	1.22	10.5	1.43	11.2	1.54	11.9	1.66	13.4	1.89	14.8	2.13		
	18	7.56	1.03	9.02	1.24	10.5	1.46	11.2	1.57	11.9	1.69	13.4	1.93	14.8	2.17		
	20	7.56	1.05	9.02	1.26	10.5	1.49	11.2	1.60	11.9	1.72	13.4	2.00	14.8	2.33		
	21	7.56	1.06	9.02	1.27	10.5	1.50	11.2	1.62	11.9	1.76	13.4	2.07	14.8	2.41		
	23	7.56	1.08	9.02	1.30	10.5	1.58	11.2	1.73	11.9	1.88	13.4	2.22	14.8	2.58		
	25	7.56	1.11	9.02	1.38	10.5	1.68	11.2	1.84	11.9	2.01	13.4	2.37	14.8	2.77		
	27	7.56	1.18	9.02	1.47	10.5	1.79	11.2	1.97	11.9	2.15	13.4	2.54	14.8	2.96		
	29	7.56	1.26	9.02	1.57	10.5	1.91	11.2	2.10	11.9	2.29	13.4	2.71	14.8	3.16		
	31	7.56	1.33	9.02	1.67	10.5	2.04	11.2	2.24	11.9	2.45	13.4	2.89	14.6	3.29		
	33	7.56	1.42	9.02	1.77	10.5	2.17	11.2	2.38	11.9	2.61	13.4	3.09	14.4	3.41		
	35	7.56	1.50	9.02	1.88	10.5	2.31	11.2	2.54	11.9	2.78	13.4	3.29	14.2	3.53		
	37	7.56	1.59	9.02	2.00	10.5	2.45	11.2	2.70	11.9	2.96	13.4	3.51	13.9	3.66		
	39	7.56	1.69	9.02	2.12	10.5	2.61	11.2	2.87	11.9	3.15	13.4	3.73	13.7	3.78		
70% 9.80 kW (88)	10	6.61	0.85	7.89	1.01	9.16	1.17	9.80	1.26	10.4	1.35	11.7	1.54	13.0	1.73		
	12	6.61	0.86	7.89	1.02	9.16	1.19	9.80	1.28	10.4	1.38	11.7	1.56	13.0	1.76		
	14	6.61	0.87	7.89	1.04	9.16	1.22	9.80	1.31	10.4	1.40	11.7	1.59	13.0	1.79		
	16	6.61	0.89	7.89	1.06	9.16	1.24	9.80	1.33	10.4	1.43	11.7	1.62	13.0	1.83		
	18	6.61	0.90	7.89	1.08	9.16	1.26	9.80	1.36	10.4	1.45	11.7	1.66	13.0	1.86		
	20	6.61	0.92	7.89	1.10	9.16	1.28	9.80	1.38	10.4	1.48	11.7	1.69	13.0	1.92		
	21	6.61	0.93	7.89	1.11	9.16	1.30	9.80	1.40	10.4	1.50	11.7	1.71	13.0	1.98		
	23	6.61	0.94	7.89	1.13	9.16	1.32	9.80	1.44	10.4	1.57	11.7	1.84	13.0	2.12		
	25	6.61	0.96	7.89	1.17	9.16	1.41	9.80	1.54	10.4	1.67	11.7	1.96	13.0	2.27		
	27	6.61	1.01	7.89	1.25	9.16	1.50	9.80	1.64	10.4	1.79	11.7	2.09	13.0	2.43		
	29	6.61	1.08	7.89	1.32	9.16	1.60	9.80	1.75	10.4	1.90	11.7	2.23	13.0	2.59		
	31	6.61	1.14	7.89	1.41	9.16	1.70	9.80	1.86	10.4	2.03	11.7	2.38	13.0	2.77		
	33	6.61	1.21	7.89	1.49	9.16	1.81	9.80	1.98	10.4	2.16	11.7	2.54	13.0	2.95		
	35	6.61	1.28	7.89	1.58	9.16	1.92	9.80	2.11	10.4	2.30	11.7	2.70	13.0	3.14		
	37	6.61	1.35	7.89	1.68	9.16	2.04	9.80	2.24	10.4	2.44	11.7	2.88	13.0	3.35		
	39	6.61	1.43	7.89	1.78	9.16	2.17	9.80	2.38	10.4	2.60	11.7	3.06	13.0	3.57		

4TW32032-1

#### NOTES - ANMERKUNGEN - Σημειώσεις - NOTAS - REMARQUES - NOTE - OPMERKINGEN - примечания - NOTLAR

- The above table shows the average value of conditions which may occur.  
Die obige Tabelle zeigt den Durchschnittswert der Bedingungen, die auftreten können.  
Στον παραπάνω πίνακα αναγράφεται η μέση τιμή για συνθήκες που μπορεί να προκύψουν.  
La tabla de arriba muestra el valor medio de condiciones que pueden ocurrir.  
Le tableau ci-dessus donne la valeur moyenne pour des conditions qui peuvent survenir.  
La tabella in alto mostra il valore delle condizioni medie che si possono riscontrare.  
De tabel hierboven geeft de gemiddelde waarde aan van situaties die kunnen voorvallen.  
Таблица расположенная выше показывает среднее значение условий, которые могут наступить.  
Yukarıdaki tablo meydana gelebilecek koşulların ortalama değerini göstermektedir.

# 5 Capacity tables

## 5 - 1 Cooling Capacity Tables

### ERQ125AW1

#### Cooling

TC: Total capacity; kW; PI: Power Input; kW (Comp. + Outdoor fan motor)

Combination % kW (Capacity index)	Outdoor air temp. (°CDB)	Indoor air temp. °CWB															
		14.0 °CWB		16.0 °CWB		18.0 °CWB		19.0 °CWB		20.0 °CWB		22.0 °CWB		24.0 °CWB			
		20.0 °CDB		23.0 °CDB		26.0 °CDB		27.0 °CDB		28.0 °CDB		30.0 °CDB		32.0 °CDB			
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
60% 8.40 kW (75)	10	5.67	0.74	6.76	0.87	7.85	1.00	8.40	1.07	8.95	1.14	10.0	1.29	11.1	1.45		
	12	5.67	0.75	6.76	0.88	7.85	1.02	8.40	1.09	8.95	1.16	10.0	1.32	11.1	1.48		
	14	5.67	0.76	6.76	0.89	7.85	1.03	8.40	1.11	8.95	1.18	10.0	1.34	11.1	1.50		
	16	5.67	0.77	6.76	0.91	7.85	1.05	8.40	1.13	8.95	1.21	10.0	1.37	11.1	1.53		
	18	5.67	0.78	6.76	0.92	7.85	1.07	8.40	1.15	8.95	1.23	10.0	1.39	11.1	1.56		
	20	5.67	0.79	6.76	0.94	7.85	1.09	8.40	1.17	8.95	1.25	10.0	1.42	11.1	1.59		
	21	5.67	0.80	6.76	0.95	7.85	1.10	8.40	1.18	8.95	1.26	10.0	1.43	11.1	1.61		
	23	5.67	0.81	6.76	0.96	7.85	1.12	8.40	1.20	8.95	1.29	10.0	1.49	11.1	1.71		
	25	5.67	0.83	6.76	0.98	7.85	1.16	8.40	1.26	8.95	1.37	10.0	1.59	11.1	1.83		
	27	5.67	0.86	6.76	1.04	7.85	1.24	8.40	1.35	8.95	1.46	10.0	1.70	11.1	1.95		
	29	5.67	0.91	6.76	1.10	7.85	1.32	8.40	1.43	8.95	1.55	10.0	1.81	11.1	2.08		
	31	5.67	0.96	6.76	1.17	7.85	1.40	8.40	1.52	8.95	1.65	10.0	1.92	11.1	2.22		
	33	5.67	1.02	6.76	1.24	7.85	1.48	8.40	1.62	8.95	1.75	10.0	2.05	11.1	2.36		
	35	5.67	1.08	6.76	1.31	7.85	1.58	8.40	1.72	8.95	1.86	10.0	2.18	11.1	2.51		
	37	5.67	1.14	6.76	1.39	7.85	1.67	8.40	1.82	8.95	1.98	10.0	2.31	11.1	2.67		
	39	5.67	1.20	6.76	1.47	7.85	1.77	8.40	1.93	8.95	2.10	10.0	2.46	11.1	2.84		
50% 7.00 kW (63)	10	4.72	0.63	5.63	0.73	6.54	0.84	7.00	0.89	7.46	0.95	8.37	1.07	9.28	1.19		
	12	4.72	0.64	5.63	0.74	6.54	0.85	7.00	0.91	7.46	0.97	8.37	1.09	9.28	1.21		
	14	4.72	0.65	5.63	0.75	6.54	0.87	7.00	0.92	7.46	0.98	8.37	1.10	9.28	1.23		
	16	4.72	0.66	5.63	0.77	6.54	0.88	7.00	0.94	7.46	1.00	8.37	1.12	9.28	1.25		
	18	4.72	0.67	5.63	0.78	6.54	0.89	7.00	0.95	7.46	1.02	8.37	1.14	9.28	1.28		
	20	4.72	0.68	5.63	0.79	6.54	0.91	7.00	0.97	7.46	1.03	8.37	1.16	9.28	1.30		
	21	4.72	0.68	5.63	0.80	6.54	0.92	7.00	0.98	7.46	1.04	8.37	1.18	9.28	1.31		
	23	4.72	0.69	5.63	0.81	6.54	0.93	7.00	1.00	7.46	1.06	8.37	1.20	9.28	1.34		
	25	4.72	0.70	5.63	0.82	6.54	0.95	7.00	1.02	7.46	1.09	8.37	1.26	9.28	1.43		
	27	4.72	0.71	5.63	0.85	6.54	1.00	7.00	1.08	7.46	1.16	8.37	1.34	9.28	1.53		
	29	4.72	0.76	5.63	0.90	6.54	1.06	7.00	1.15	7.46	1.24	8.37	1.42	9.28	1.63		
	31	4.72	0.80	5.63	0.96	6.54	1.13	7.00	1.22	7.46	1.31	8.37	1.51	9.28	1.73		
	33	4.72	0.84	5.63	1.01	6.54	1.19	7.00	1.29	7.46	1.39	8.37	1.61	9.28	1.84		
	35	4.72	0.89	5.63	1.07	6.54	1.26	7.00	1.37	7.46	1.48	8.37	1.71	9.28	1.95		
	37	4.72	0.94	5.63	1.13	6.54	1.34	7.00	1.45	7.46	1.57	8.37	1.81	9.28	2.08		
	39	4.72	0.99	5.63	1.19	6.54	1.42	7.00	1.53	7.46	1.66	8.37	1.92	9.28	2.20		

# 5 Capacity tables

## 5 - 1 Cooling Capacity Tables

### ERQ200AW1

#### Cooling

TC: Total capacity; kW; PI: Power Input; kW (Comp. + Outdoor fan motor)

Combination % kW (Capacity index)	Outdoor air temp. (°CDB)	Indoor air temp. °CWB															
		14.0 °CWB 20.0 °CDB		16.0 °CWB 23.0 °CDB		18.0 °CWB 26.0 °CDB		19.0 °CWB 27.0 °CDB		20.0 °CWB 28.0 °CDB		22.0 °CWB 30.0 °CDB		24.0 °CWB 32.0 °CDB			
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
100% 22.40 kW (200)	10	15.1	1.80	18.0	2.18	20.9	2.58	22.4	2.79	23.9	3.00	26.8	3.43	28.3	3.55		
	12	15.1	1.83	18.0	2.22	20.9	2.63	22.4	2.84	23.9	3.06	26.8	3.50	28.0	3.53		
	14	15.1	1.86	18.0	2.26	20.9	2.68	22.4	2.90	23.9	3.12	26.8	3.56	27.6	3.51		
	16	15.1	1.90	18.0	2.31	20.9	2.73	22.4	2.96	23.9	3.18	26.7	3.61	27.2	3.57		
	18	15.1	1.93	18.0	2.35	20.9	2.79	22.4	3.01	23.9	3.24	26.3	3.73	26.9	3.75		
	20	15.1	1.97	18.0	2.40	20.9	2.87	22.4	3.17	23.9	3.47	26.0	3.91	26.5	3.94		
	21	15.1	1.99	18.0	2.42	20.9	2.97	22.4	3.28	23.9	3.60	25.8	4.00	26.3	4.03		
	23	15.1	2.04	18.0	2.58	20.9	3.19	22.4	3.51	23.9	3.86	25.4	4.18	25.9	4.21		
	25	15.1	2.18	18.0	2.76	20.9	3.41	22.4	3.76	23.9	4.13	25.0	4.36	25.6	4.40		
	27	15.1	2.32	18.0	2.94	20.9	3.64	22.4	4.02	23.9	4.42	24.7	4.55	25.2	4.58		
90% 20.16 kW (180)	29	15.1	2.47	18.0	3.14	20.9	3.89	22.4	4.30	23.8	4.69	24.3	4.73	24.9	4.77		
	31	15.1	2.63	18.0	3.35	20.9	4.15	22.4	4.59	23.4	4.88	23.9	4.92	24.5	4.96		
	33	15.1	2.80	18.0	3.56	20.9	4.43	22.4	4.89	23.0	5.06	23.6	5.10	24.1	5.15		
	35	15.1	2.97	18.0	3.79	20.9	4.72	22.4	5.22	22.7	5.24	23.2	5.29	23.8	5.34		
	37	15.1	3.16	18.0	4.04	20.9	5.03	22.0	5.40	22.3	5.43	22.9	5.48	23.4	5.53		
	39	15.1	3.35	18.0	4.29	20.9	5.35	21.7	5.59	21.9	5.61	22.5	5.67	23.0	5.72		
	10	13.6	1.61	16.2	1.94	18.8	2.29	20.2	2.47	21.5	2.68	24.1	3.04	26.7	3.42		
	12	13.6	1.64	16.2	1.98	18.8	2.33	20.2	2.52	21.5	2.71	24.1	3.09	26.7	3.49		
	14	13.6	1.67	16.2	2.01	18.8	2.38	20.2	2.57	21.5	2.76	24.1	3.15	26.7	3.55		
	16	13.6	1.69	16.2	2.05	18.8	2.42	20.2	2.62	21.5	2.81	24.1	3.22	26.7	3.61		
80% 17.92 kW (160)	18	13.6	1.73	16.2	2.09	18.8	2.47	20.2	2.67	21.5	2.87	24.1	3.28	26.3	3.73		
	20	13.6	1.76	16.2	2.13	18.8	2.52	20.2	2.72	21.5	2.98	24.1	3.52	25.9	3.91		
	21	13.6	1.77	16.2	2.15	18.8	2.56	20.2	2.82	21.5	3.08	24.1	3.65	25.8	4.00		
	23	13.6	1.81	16.2	2.24	18.8	2.74	20.2	3.02	21.5	3.30	24.1	3.92	25.4	4.18		
	25	13.6	1.90	16.2	2.39	18.8	2.93	20.2	3.23	21.5	3.53	24.1	4.19	25.0	4.36		
	27	13.6	2.03	16.2	2.55	18.8	3.13	20.2	3.45	21.5	3.78	24.1	4.49	24.7	4.55		
	29	13.6	2.16	16.2	2.72	18.8	3.34	20.2	3.68	21.5	4.04	23.8	4.70	24.3	4.73		
	31	13.6	2.29	16.2	2.89	18.8	3.56	20.2	3.93	21.5	4.31	23.4	4.88	23.9	4.92		
	33	13.6	2.44	16.2	3.08	18.8	3.80	20.2	4.19	21.5	4.59	23.1	5.06	23.6	5.10		
	35	13.6	2.59	16.2	3.27	18.8	4.04	20.2	4.46	21.5	4.90	22.7	5.25	23.2	5.29		
70% 15.68 kW (140)	37	13.6	2.74	16.2	3.48	18.8	4.30	20.2	4.75	21.5	5.22	22.4	5.43	22.8	5.48		
	39	13.6	2.91	16.2	3.70	18.8	4.58	20.2	5.06	21.5	5.56	22.0	5.62	22.5	5.66		
	10	12.1	1.43	14.4	1.71	16.8	2.01	17.9	2.17	19.1	2.33	21.4	2.65	23.7	2.99		
	12	12.1	1.45	14.4	1.74	16.8	2.05	17.9	2.21	19.1	2.37	21.4	2.70	23.7	3.04		
	14	12.1	1.48	14.4	1.77	16.8	2.08	17.9	2.25	19.1	2.41	21.4	2.75	23.7	3.10		
	16	12.1	1.50	14.4	1.80	16.8	2.12	17.9	2.29	19.1	2.46	21.4	2.81	23.7	3.16		
	18	12.1	1.53	14.4	1.84	16.8	2.16	17.9	2.33	19.1	2.51	21.4	2.86	23.7	3.22		
	20	12.1	1.55	14.4	1.87	16.8	2.21	17.9	2.38	19.1	2.56	21.4	2.97	23.7	3.45		
	21	12.1	1.57	14.4	1.89	16.8	2.23	17.9	2.40	19.1	2.61	21.4	3.07	23.7	3.57		
	23	12.1	1.60	14.4	1.93	16.8	2.34	17.9	2.56	19.1	2.79	21.4	3.29	23.7	3.83		
	25	12.1	1.65	14.4	2.05	16.8	2.49	17.9	2.73	19.1	2.99	21.4	3.52	23.7	4.10		
	27	12.1	1.75	14.4	2.18	16.8	2.66	17.9	2.92	19.1	3.19	21.4	3.76	23.7	4.39		
	29	12.1	1.86	14.4	2.32	16.8	2.84	17.9	3.11	19.1	3.40	21.4	4.02	23.7	4.69		
	31	12.1	1.98	14.4	2.47	16.8	3.02	17.9	3.32	19.1	3.63	21.4	4.29	23.4	4.87		
	33	12.1	2.10	14.4	2.63	16.8	3.22	17.9	3.53	19.1	3.86	21.4	4.58	23.0	5.06		
	35	12.1	2.23	14.4	2.79	16.8	3.42	17.9	3.76	19.1	4.12	21.4	4.88	22.7	5.24		
	37	12.1	2.36	14.4	2.96	16.8	3.64	17.9	4.00	19.1	4.38	21.4	5.20	22.3	5.43		
	39	12.1	2.50	14.4	3.15	16.8	3.87	17.9	4.26	19.1	4.66	21.4	5.54	21.9	5.61		
	10	10.6	1.26	12.6	1.49	14.7	1.74	15.7	1.87	16.7	2.00	18.7	2.28	20.8	2.56		
	12	10.6	1.28	12.6	1.52	14.7	1.77	15.7	1.90	16.7	2.04	18.7	2.32	20.8	2.61		
	14	10.6	1.30	12.6	1.54	14.7	1.80	15.7	1.94	16.7	2.08	18.7	2.36	20.8	2.66		
	16	10.6	1.32	12.6	1.57	14.7	1.83	15.7	1.97	16.7	2.12	18.7	2.41	20.8	2.71		
	18	10.6	1.34	12.6	1.60	14.7	1.87	15.7	2.01	16.7	2.16	18.7	2.45	20.8	2.76		
	20	10.6	1.36	12.6	1.62	14.7	1.90	15.7	2.05	16.7	2.20	18.7	2.50	20.8	2.84		
	21	10.6	1.37	12.6	1.64	14.7	1.92	15.7	2.07	16.7	2.22	18.7	2.54	20.8	2.94		
	23	10.6	1.40	12.6	1.67	14.7	1.96	15.7	2.14	16.7	2.33	18.7	2.72	20.8	3.15		
	25	10.6	1.42	12.6	1.74	14.7	2.09	15.7	2.28	16.7	2.48	18.7	2.91	20.8	3.37		
	27	10.6	1.50	12.6	1.85	14.7	2.23	15.7	2.43	16.7	2.65	18.7	3.11	20.8	3.60		
	29	10.6	1.59	12.6	1.96	14.7	2.37	15.7	2.59	16.7	2.82	18.7	3.31	20.8	3.85		
	31	10.6	1.69	12.6	2.09	14.7	2.52	15.7	2.76	16.7	3.01	18.7	3.53	20.8	4.10		
	33	10.6	1.79	12.6	2.21	14.7	2.68	15.7	2.94	16.7	3.20	18.7	3.76	20.8	4.38		
	35	10.6	1.90	12.6	2.35	14.7	2.85	15.7	3.12	16.7	3.40	18.7	4.01	20.8	4.66		
	37	10.6	2.01	12.6	2.49	14.7	3.03	15.7	3.32	16.7	3.62	18.7	4.27	20.8	4.97		
	39	10.6	2.13	12.6	2.64	14.7	3.22	15.7	3.52	16.7	3.85	18.7	4.54	20.8	5.29		

4TW32032-1

#### NOTES - ANMERKUNGEN - Σημειώσεις - NOTAS - REMARQUES - NOTE - OPMERKINGEN - примечания - NOTLAR

- The above table shows the average value of conditions which may occur.  
Die obige Tabelle zeigt den Durchschnittswert der Bedingungen, die auftreten können.  
Στον παραπάνω πίνακα αναγράφεται η μέση τιμή για συνθήκες που μπορεί να προκύψουν.  
La tabla de arriba muestra el valor medio de condiciones que pueden ocurrir.  
Le tableau ci-dessus donne la valeur moyenne pour des conditions qui peuvent survenir.  
La tabella in alto mostra il valore delle condizioni medie che si possono riscontrare.  
De tabel hierboven geeft de gemiddelde waarde aan van situaties die kunnen voorvallen.  
Таблица расположенная выше показывает среднее значение условий, которые могут наступить.  
Yukarıdaki tablo meydana gelebilecek koşulların ortalama değerini göstermektedir.

# 5 Capacity tables

## 5 - 1 Cooling Capacity Tables

### ERQ200AW1

#### Cooling

TC: Total capacity; kW; PI: Power Input; kW (Comp. + Outdoor fan motor)

Combination % kW (Capacity index)	Outdoor air temp. (°CDB)	Indoor air temp. °CWB															
		14.0 °CWB		16.0 °CWB		18.0 °CWB		19.0 °CWB		20.0 °CWB		22.0 °CWB		24.0 °CWB			
		20.0 °CDB		23.0 °CDB		26.0 °CDB		27.0 °CDB		28.0 °CDB		30.0 °CDB		32.0 °CDB			
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
60% 13.44 kW (120)	10	9.1	1.09	10.8	1.28	12.6	1.48	13.4	1.59	14.3	1.70	16.1	1.92	17.8	2.15		
	12	9.1	1.11	10.8	1.30	12.6	1.51	13.4	1.62	14.3	1.73	16.1	1.95	17.8	2.19		
	14	9.1	1.12	10.8	1.32	12.6	1.53	13.4	1.64	14.3	1.76	16.1	1.99	17.8	2.23		
	16	9.1	1.14	10.8	1.34	12.6	1.56	13.4	1.67	14.3	1.79	16.1	2.03	17.8	2.27		
	18	9.1	1.16	10.8	1.37	12.6	1.59	13.4	1.70	14.3	1.82	16.1	2.06	17.8	2.32		
	20	9.1	1.18	10.8	1.39	12.6	1.62	13.4	1.73	14.3	1.86	16.1	2.10	17.8	2.36		
	21	9.1	1.19	10.8	1.40	12.6	1.63	13.4	1.75	14.3	1.87	16.1	2.12	17.8	2.39		
	23	9.1	1.21	10.8	1.43	12.6	1.66	13.4	1.78	14.3	1.91	16.1	2.21	17.8	2.54		
	25	9.1	1.23	10.8	1.45	12.6	1.73	13.4	1.87	14.3	2.03	16.1	2.36	17.8	2.71		
	27	9.1	1.27	10.8	1.54	12.6	1.84	13.4	2.00	14.3	2.16	16.1	2.51	17.8	2.89		
	29	9.1	1.35	10.8	1.63	12.6	1.95	13.4	2.12	14.3	2.30	16.1	2.68	17.8	3.09		
	31	9.1	1.43	10.8	1.73	12.6	2.07	13.4	2.26	14.3	2.45	16.1	2.85	17.8	3.29		
	33	9.1	1.51	10.8	1.84	12.6	2.20	13.4	2.40	14.3	2.60	16.1	3.03	17.8	3.50		
	35	9.1	1.59	10.8	1.95	12.6	2.34	13.4	2.54	14.3	2.76	16.1	3.23	17.8	3.73		
	37	9.1	1.69	10.8	2.06	12.6	2.48	13.4	2.70	14.3	2.93	16.1	3.43	17.8	3.97		
	39	9.1	1.78	10.8	2.18	12.6	2.63	13.4	2.86	14.3	3.11	16.1	3.64	17.8	4.22		
50% 11.20 kW (100)	10	7.56	0.94	9.0	1.09	10.5	1.24	11.2	1.33	11.9	1.41	13.4	1.58	14.8	1.76		
	12	7.56	0.95	9.0	1.10	10.5	1.26	11.2	1.35	11.9	1.43	13.4	1.61	14.8	1.79		
	14	7.56	0.96	9.0	1.12	10.5	1.28	11.2	1.37	11.9	1.46	13.4	1.64	14.8	1.83		
	16	7.56	0.98	9.0	1.14	10.5	1.30	11.2	1.39	11.9	1.48	13.4	1.67	14.8	1.86		
	18	7.56	0.99	9.0	1.15	10.5	1.32	11.2	1.41	11.9	1.51	13.4	1.70	14.8	1.89		
	20	7.56	1.01	9.0	1.17	10.5	1.35	11.2	1.44	11.9	1.53	13.4	1.73	14.8	1.93		
	21	7.56	1.01	9.0	1.18	10.5	1.36	11.2	1.45	11.9	1.55	13.4	1.74	14.8	1.95		
	23	7.56	1.03	9.0	1.20	10.5	1.38	11.2	1.48	11.9	1.57	13.4	1.78	14.8	1.99		
	25	7.56	1.04	9.0	1.22	10.5	1.41	11.2	1.51	11.9	1.62	13.4	1.87	14.8	2.13		
	27	7.56	1.06	9.0	1.26	10.5	1.48	11.2	1.60	11.9	1.73	13.4	1.99	14.8	2.27		
	29	7.56	1.12	9.0	1.34	10.5	1.58	11.2	1.70	11.9	1.83	13.4	2.11	14.8	2.41		
	31	7.56	1.18	9.0	1.42	10.5	1.67	11.2	1.81	11.9	1.95	13.4	2.25	14.8	2.57		
	33	7.56	1.25	9.0	1.50	10.5	1.77	11.2	1.91	11.9	2.07	13.4	2.38	14.8	2.73		
	35	7.56	1.32	9.0	1.58	10.5	1.87	11.2	2.03	11.9	2.19	13.4	2.53	14.8	2.90		
	37	7.56	1.39	9.0	1.67	10.5	1.98	11.2	2.15	11.9	2.32	13.4	2.69	14.8	3.08		
	39	7.56	1.47	9.0	1.77	10.5	2.10	11.2	2.28	11.9	2.46	13.4	2.85	14.8	3.27		



# 5 Capacity tables

## 5 - 1 Cooling Capacity Tables

### ERQ250AW1

#### Cooling

TC: Total capacity; kW; PI: Power Input; kW (Comp. + Outdoor fan motor)

Combination % kW (Capacity index)	Outdoor air temp. (°CDB)	Indoor air temp. °CWB															
		14.0 °CWB		16.0 °CWB		18.0 °CWB		19.0 °CWB		20.0 °CWB		22.0 °CWB		24.0 °CWB			
		20.0 °CDB		23.0 °CDB		26.0 °CDB		27.0 °CDB		28.0 °CDB		30.0 °CDB		32.0 °CDB			
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
100% 28.00 kW (250)	10	18.9	2.56	22.5	3.10	26.2	3.67	28.0	3.97	29.8	4.27	33.5	4.88	35.4	5.05		
	12	18.9	2.60	22.5	3.16	26.2	3.74	28.0	4.04	29.8	4.35	33.5	4.97	34.9	5.02		
	14	18.9	2.65	22.5	3.22	26.2	3.81	28.0	4.12	29.8	4.43	33.5	5.07	34.5	4.99		
	16	18.9	2.70	22.5	3.28	26.2	3.89	28.0	4.20	29.8	4.52	33.3	5.13	34.0	5.08		
	18	18.9	2.75	22.5	3.34	26.2	3.96	28.0	4.28	29.8	4.61	32.9	5.20	33.6	5.14		
	20	18.9	2.80	22.5	3.41	26.2	4.03	28.0	4.36	29.8	4.70	32.4	5.27	33.1	5.20		
	21	18.9	2.83	22.5	3.44	26.2	4.06	28.0	4.39	29.8	4.73	32.2	5.29	32.9	5.22		
	23	18.9	2.90	22.5	3.51	26.2	4.13	28.0	4.46	29.8	4.80	31.8	5.34	32.4	5.27		
	25	18.9	2.97	22.5	3.58	26.2	4.20	28.0	4.53	29.8	4.87	31.3	5.39	32.0	5.30		
	27	18.9	3.03	22.5	3.64	26.2	4.26	28.0	4.59	29.8	4.93	30.8	5.44	31.5	5.35		
90% 25.20 kW (225)	29	18.9	3.10	22.5	3.71	26.2	4.33	28.0	4.66	29.8	5.00	30.4	5.49	31.1	5.40		
	31	18.9	3.17	22.5	3.78	26.2	4.40	28.0	4.73	29.8	5.07	30.0	5.54	30.6	5.45		
	33	18.9	3.24	22.5	3.85	26.2	4.47	28.0	4.80	29.8	5.14	29.5	5.59	30.2	5.50		
	35	18.9	3.31	22.5	3.92	26.2	4.54	28.0	4.87	29.8	5.21	29.0	5.64	29.7	5.55		
	37	18.9	3.38	22.5	4.00	26.2	4.61	28.0	4.94	29.8	5.28	28.6	5.69	29.2	5.60		
	39	18.9	3.45	22.5	4.07	26.2	4.68	28.0	5.01	29.8	5.35	28.1	5.74	28.8	5.65		
	10	17.0	2.29	20.3	2.76	23.6	3.26	25.2	3.52	26.8	3.78	30.1	4.32	33.4	4.87		
	12	17.0	2.33	20.3	2.81	23.6	3.32	25.2	3.58	26.8	3.85	30.1	4.40	33.4	4.96		
	14	17.0	2.37	20.3	2.86	23.6	3.38	25.2	3.65	26.8	3.92	30.1	4.48	33.4	5.05		
	16	17.0	2.41	20.3	2.91	23.6	3.45	25.2	3.72	26.8	4.00	30.1	4.57	33.3	5.14		
80% 22.40 kW (200)	18	17.0	2.45	20.3	2.97	23.6	3.51	25.2	3.79	26.8	4.08	30.1	4.66	32.9	5.20		
	20	17.0	2.50	20.3	3.03	23.6	3.58	25.2	3.87	26.8	4.23	30.1	4.75	32.4	5.25		
	21	17.0	2.52	20.3	3.06	23.6	3.64	25.2	3.90	26.8	4.26	30.1	4.78	32.2	5.27		
	23	17.0	2.57	20.3	3.12	23.6	3.70	25.2	3.96	26.8	4.32	30.1	4.84	31.7	5.32		
	25	17.0	2.61	20.3	3.17	23.6	3.75	25.2	4.01	26.8	4.37	30.1	4.89	31.3	5.36		
	27	17.0	2.66	20.3	3.23	23.6	3.81	25.2	4.07	26.8	4.43	30.1	4.95	30.8	5.41		
	29	17.0	2.71	20.3	3.28	23.6	3.86	25.2	4.12	26.8	4.48	29.8	4.99	30.4	5.45		
	31	17.0	2.76	20.3	3.34	23.6	3.92	25.2	4.18	26.8	4.54	29.3	5.04	29.9	5.50		
	33	17.0	2.81	20.3	3.39	23.6	3.97	25.2	4.23	26.8	4.59	28.9	5.09	29.5	5.54		
	35	17.0	2.86	20.3	3.45	23.6	4.03	25.2	4.29	26.8	4.65	28.4	5.14	29.0	5.59		
70% 19.60 kW (175)	37	17.0	2.91	20.3	3.50	23.6	4.08	25.2	4.34	26.8	4.70	27.9	5.19	28.6	5.64		
	39	17.0	2.96	20.3	3.56	23.6	4.14	25.2	4.40	26.8	4.76	27.5	5.24	28.1	5.69		
	10	15.1	2.03	18.0	2.43	20.9	2.86	22.4	3.08	23.9	3.30	26.8	3.77	29.7	4.25		
	12	15.1	2.06	18.0	2.47	20.9	2.91	22.4	3.14	23.9	3.37	26.8	3.84	29.7	4.33		
	14	15.1	2.10	18.0	2.52	20.9	2.96	22.4	3.19	23.9	3.43	26.8	3.91	29.7	4.41		
	16	15.1	2.13	18.0	2.56	20.9	3.02	22.4	3.25	23.9	3.49	26.8	3.99	29.7	4.49		
	18	15.1	2.17	18.0	2.61	20.9	3.08	22.4	3.32	23.9	3.56	26.8	4.07	29.7	4.58		
	20	15.1	2.21	18.0	2.66	20.9	3.14	22.4	3.38	23.9	3.63	26.8	4.15	29.7	4.66		
	21	15.1	2.23	18.0	2.68	20.9	3.17	22.4	3.42	23.9	3.71	26.8	4.20	29.7	4.70		
	23	15.1	2.27	18.0	2.74	20.9	3.23	22.4	3.48	23.9	3.77	26.8	4.26	29.7	4.76		

4TW32032-1

#### NOTES - ANMERKUNGEN - Σημειώσεις - NOTAS - REMARQUES - NOTE - OPMERKINGEN - примечания - NOTLAR

- The above table shows the average value of conditions which may occur.  
Die obige Tabelle zeigt den Durchschnittswert der Bedingungen, die auftreten können.  
Στον παραπάνω πίνακα αναγράφεται η μέση τιμή για συνθήκες που μπορεί να προκύψουν.  
La tabla de arriba muestra el valor medio de condiciones que pueden ocurrir.  
Le tableau ci-dessus donne la valeur moyenne pour des conditions qui peuvent survenir.  
La tabella in alto mostra il valore delle condizioni medie che si possono riscontrare.  
De tabel hierboven geeft de gemiddelde waarde aan van situaties die kunnen voorvallen.  
Таблица расположенная выше показывает среднее значение условий, которые могут наступить.  
Yukarıdaki tablo meydana gelebilecek koşulların ortalama değerini göstermektedir.

5 Capacity tables  
5 - 1 Cooling Capacity Tables

ERQ250AW1  
Cooling

TC: Total capacity; kW; PI: Power Input; kW (Comp. + Outdoor fan motor)

Combination % kW (Capacity index)	Outdoor air temp. (°CDB)	Indoor air temp. °CWB															
		14.0 °CWB		16.0 °CWB		18.0 °CWB		19.0 °CWB		20.0 °CWB		22.0 °CWB		24.0 °CWB			
		20.0 °CDB		23.0 °CDB		26.0 °CDB		27.0 °CDB		28.0 °CDB		30.0 °CDB		32.0 °CDB			
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
60% 16.80 kW (150)	10	11.3	1.55	13.5	1.82	15.7	2.11	16.8	2.26	17.9	2.41	20.1	2.73	22.3	3.06		
	12	11.3	1.58	13.5	1.85	15.7	2.15	16.8	2.30	17.9	2.45	20.1	2.78	22.3	3.11		
	14	11.3	1.60	13.5	1.88	15.7	2.18	16.8	2.34	17.9	2.50	20.1	2.83	22.3	3.17		
	16	11.3	1.62	13.5	1.91	15.7	2.22	16.8	2.38	17.9	2.54	20.1	2.88	22.3	3.23		
	18	11.3	1.65	13.5	1.94	15.7	2.26	16.8	2.42	17.9	2.59	20.1	2.93	22.3	3.29		
	20	11.3	1.67	13.5	1.98	15.7	2.30	16.8	2.47	17.9	2.64	20.1	2.99	22.3	3.36		
	21	11.3	1.69	13.5	1.99	15.7	2.32	16.8	2.49	17.9	2.66	20.1	3.02	22.3	3.39		
	23	11.3	1.71	13.5	2.03	15.7	2.36	16.8	2.54	17.9	2.71	20.1	3.14	22.3	3.61		
	25	11.3	1.74	13.5	2.06	15.7	2.45	16.8	2.66	17.9	2.88	20.1	3.35	22.3	3.85		
	27	11.3	1.81	13.5	2.19	15.7	2.61	16.8	2.84	17.9	3.07	20.1	3.57	22.3	4.11		
	29	11.3	1.91	13.5	2.32	15.7	2.78	16.8	3.02	17.9	3.27	20.1	3.81	22.3	4.39		
	31	11.3	2.03	13.5	2.46	15.7	2.95	16.8	3.21	17.9	3.48	20.1	4.05	22.3	4.67		
	33	11.3	2.14	13.5	2.61	15.7	3.13	16.8	3.41	17.9	3.70	20.1	4.31	22.3	4.98		
	35	11.3	2.27	13.5	2.77	15.7	3.32	16.8	3.62	17.9	3.93	20.1	4.59	22.3	5.30		
	37	11.3	2.40	13.5	2.93	15.7	3.52	16.8	3.84	17.9	4.17	20.1	4.88	22.3	5.64		
	39	11.3	2.53	13.5	3.10	15.7	3.73	16.8	4.07	17.9	4.43	20.1	5.18	22.3	6.00		
50% 14.00 kW (125)	10	9.45	1.34	11.3	1.55	13.1	1.77	14.0	1.89	14.9	2.00	16.7	2.25	18.6	2.51		
	12	9.45	1.35	11.3	1.57	13.1	1.80	14.0	1.91	14.9	2.04	16.7	2.29	18.6	2.55		
	14	9.45	1.37	11.3	1.59	13.1	1.82	14.0	1.95	14.9	2.07	16.7	2.33	18.6	2.60		
	16	9.45	1.39	11.3	1.61	13.1	1.85	14.0	1.98	14.9	2.10	16.7	2.37	18.6	2.64		
	18	9.45	1.41	11.3	1.64	13.1	1.88	14.0	2.01	14.9	2.14	16.7	2.41	18.6	2.69		
	20	9.45	1.43	11.3	1.66	13.1	1.91	14.0	2.04	14.9	2.18	16.7	2.45	18.6	2.74		
	21	9.45	1.44	11.3	1.68	13.1	1.93	14.0	2.06	14.9	2.20	16.7	2.48	18.6	2.77		
	23	9.45	1.46	11.3	1.70	13.1	1.96	14.0	2.10	14.9	2.24	16.7	2.52	18.6	2.83		
	25	9.45	1.48	11.3	1.73	13.1	2.00	14.0	2.14	14.9	2.31	16.7	2.65	18.6	3.02		
	27	9.45	1.51	11.3	1.80	13.1	2.11	14.0	2.28	14.9	2.45	16.7	2.82	18.6	3.22		
	29	9.45	1.59	11.3	1.90	13.1	2.24	14.0	2.42	14.9	2.61	16.7	3.00	18.6	3.43		
	31	9.45	1.68	11.3	2.01	13.1	2.37	14.0	2.57	14.9	2.77	16.7	3.19	18.6	3.65		
	33	9.45	1.78	11.3	2.13	13.1	2.52	14.0	2.72	14.9	2.94	16.7	3.39	18.6	3.88		
	35	9.45	1.88	11.3	2.25	13.1	2.66	14.0	2.88	14.9	3.11	16.7	3.60	18.6	4.12		
	37	9.45	1.98	11.3	2.38	13.1	2.82	14.0	3.05	14.9	3.30	16.7	3.82	18.6	4.38		
	39	9.45	2.09	11.3	2.51	13.1	2.98	14.0	3.23	14.9	3.50	16.7	4.05	18.6	4.65		

## 5 Capacity tables

### 5 - 2 Heating Capacity Tables

#### ERQ125AW1

##### Heating

TC: Total capacity; kW; PI: Power Input; kW (Comp. + Outdoor fan motor)

Combination % kW (Capacity index)	Outdoor air temp.		Indoor air temp. °CWB											
			16.0		18.0		20.0		21.0		22.0		24.0	
			TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
100% 14.00 kW (125)	°CDB	°CWB												
	-19.8	-20.0	10.4	3.61	10.4	3.76	10.4	3.91	10.3	3.98	10.3	4.06	10.3	4.20
	-18.8	-19.0	10.7	3.69	10.7	3.84	10.7	3.98	10.7	4.05	10.6	4.12	10.6	4.27
	-16.7	-17.0	11.3	3.84	11.3	3.98	11.3	4.11	11.3	4.18	11.3	4.25	11.2	4.38
	-13.7	-15.0	12.0	3.97	11.9	4.10	11.9	4.23	11.9	4.29	11.9	4.36	11.9	4.49
	-11.8	-13.0	12.6	4.09	12.6	4.21	12.5	4.34	12.5	4.40	12.5	4.46	12.5	4.58
	-9.8	-11.0	13.2	4.20	13.2	4.32	13.2	4.43	13.2	4.49	13.1	4.55	13.1	4.66
	-9.5	-10.0	13.5	4.25	13.5	4.36	13.5	4.48	13.5	4.53	13.5	4.59	13.4	4.70
	-8.5	-9.1	13.8	4.30	13.8	4.41	13.8	4.52	13.7	4.57	13.7	4.63	13.7	4.74
	-7.0	-7.6	14.3	4.36	14.3	4.47	14.2	4.58	14.2	4.63	14.2	4.68	13.9	4.67
	-5.0	-5.6	14.9	4.45	14.9	4.55	14.9	4.65	14.8	4.70	14.8	4.76	13.9	4.42
	-3.0	-3.7	15.5	4.52	15.5	4.62	15.5	4.72	15.4	4.77	15.0	4.60	13.9	4.21
	0.0	-0.7	16.4	4.63	16.4	4.72	16.0	4.63	15.5	4.45	15.0	4.27	13.9	3.92
	3.0	2.2	17.4	4.72	17.0	4.68	16.0	4.34	15.5	4.17	15.0	4.00	13.9	3.68
	5.0	4.1	18.0	4.78	17.0	4.49	16.0	4.16	15.5	4.00	15.0	3.84	13.9	3.54
90% 12.60 kW (113)	7.0	6.0	18.1	4.63	17.0	4.31	16.0	4.00	15.5	3.85	15.0	3.70	13.9	3.40
	9.0	7.9	18.1	4.45	17.0	4.15	16.0	3.85	15.5	3.71	15.0	3.56	13.9	3.28
	11.0	9.8	18.1	4.29	17.0	4.00	16.0	3.71	15.5	3.57	15.0	3.44	13.9	3.17
	13.0	11.8	18.1	4.13	17.0	3.85	16.0	3.58	15.5	3.45	15.0	3.32	13.9	3.06
	15.0	13.7	18.1	3.99	17.0	3.72	16.0	3.46	15.5	3.33	15.0	3.21	13.9	2.96
	-19.8	-20.0	10.4	3.87	10.3	4.00	10.3	4.14	10.3	4.20	10.3	4.27	10.3	4.40
	-18.8	-19.0	10.7	3.94	10.6	4.07	10.6	4.20	10.6	4.27	10.6	4.33	10.6	4.46
	-16.7	-17.0	11.3	4.08	11.3	4.20	11.2	4.32	11.2	4.38	11.2	4.44	11.2	4.57
	-13.7	-15.0	11.9	4.20	11.9	4.31	11.9	4.43	11.9	4.49	11.8	4.54	11.8	4.66
	-11.8	-13.0	12.6	4.31	12.5	4.42	12.5	4.53	12.5	4.58	12.5	4.63	12.4	4.74
	-9.8	-11.0	13.2	4.40	13.2	4.51	13.1	4.61	13.1	4.66	13.1	4.72	12.5	4.52
	-9.5	-10.0	13.5	4.45	13.5	4.55	13.4	4.65	13.4	4.70	13.4	4.75	12.5	4.39
	-8.5	-9.1	13.8	4.49	13.7	4.59	13.7	4.69	13.7	4.74	13.5	4.67	12.5	4.28
	-7.0	-7.6	14.2	4.55	14.2	4.65	14.2	4.74	13.9	4.66	13.5	4.47	12.5	4.10
	-5.0	-5.6	14.9	4.63	14.8	4.72	14.4	4.60	13.9	4.42	13.5	4.24	12.5	3.90
	-3.0	-3.7	15.5	4.70	15.3	4.73	14.4	4.38	13.9	4.21	13.5	4.04	12.5	3.72
80% 11.20 kW (100)	0.0	-0.7	16.3	4.72	15.3	4.40	14.4	4.08	13.9	3.92	13.5	3.77	12.5	3.47
	3.0	2.2	16.3	4.42	15.3	4.12	14.4	3.82	13.9	3.68	13.5	3.53	12.5	3.26
	5.0	4.1	16.3	4.24	15.3	3.95	14.4	3.67	13.9	3.53	13.5	3.40	12.5	3.13
	7.0	6.0	16.3	4.07	15.3	3.80	14.4	3.53	13.9	3.40	13.5	3.27	12.5	3.02
	9.0	7.9	16.3	3.92	15.3	3.66	14.4	3.40	13.9	3.28	13.5	3.16	12.5	2.91
	11.0	9.8	16.3	3.78	15.3	3.53	14.4	3.29	13.9	3.17	13.5	3.05	12.5	2.82
	13.0	11.8	16.3	3.65	15.3	3.41	14.4	3.17	13.9	3.06	13.5	2.94	12.5	2.72
	15.0	13.7	16.3	3.52	15.3	3.29	14.4	3.07	13.9	2.96	13.5	2.85	12.5	2.64
	-19.8	-20.0	10.3	4.13	10.3	4.25	10.3	4.37	10.3	4.43	10.2	4.49	10.2	4.60
	-18.8	-19.0	10.6	4.20	10.6	4.31	10.6	4.43	10.6	4.48	10.6	4.54	10.5	4.66
	-16.7	-17.0	11.2	4.32	11.2	4.42	11.2	4.53	11.2	4.59	11.2	4.64	11.2	4.75
	-13.7	-15.0	11.9	4.42	11.9	4.53	11.8	4.63	11.8	4.68	11.8	4.73	11.2	4.43
	-11.8	-13.0	12.5	4.52	12.5	4.62	12.5	4.71	12.4	4.73	12.0	4.54	11.2	4.16
	-9.8	-11.0	13.1	4.61	13.1	4.70	12.8	4.63	12.4	4.45	12.0	4.27	11.2	3.92
	-9.5	-10.0	13.4	4.65	13.4	4.74	12.8	4.50	12.4	4.32	12.0	4.15	11.2	3.81
	-8.5	-9.1	13.7	4.68	13.6	4.73	12.8	4.38	12.4	4.21	12.0	4.04	11.2	3.72
	-7.0	-7.6	14.2	4.74	13.6	4.53	12.8	4.20	12.4	4.04	12.0	3.88	11.2	3.57
	-5.0	-5.6	14.4	4.62	13.6	4.30	12.8	3.99	12.4	3.84	12.0	3.69	11.2	3.39
	-3.0	-3.7	14.4	4.40	13.6	4.10	12.8	3.80	12.4	3.66	12.0	3.52	11.2	3.24
	0.0	-0.7	14.4	4.09	13.6	3.82	12.8	3.55	12.4	3.41	12.0	3.28	11.2	3.03
	3.0	2.2	14.4	3.84	13.6	3.58	12.8	3.33	12.4	3.21	12.0	3.09	11.2	2.85
	5.0	4.1	14.4	3.68	13.6	3.44	12.8	3.20	12.4	3.09	12.0	2.97	11.2	2.75
	7.0	6.0	14.4	3.55	13.6	3.31	12.8	3.09	12.4	2.97	12.0	2.86	11.2	2.65
	9.0	7.9	14.4	3.42	13.6	3.19	12.8	2.98	12.4	2.87	12.0	2.77	11.2	2.56
	11.0	9.8	14.4	3.30	13.6	3.09	12.8	2.88	12.4	2.78	12.0	2.67	11.2	2.48
	13.0	11.8	14.4	3.18	13.6	2.98	12.8	2.78	12.4	2.68	12.0	2.59	11.2	2.40
	15.0	13.7	14.4	3.08	13.6	2.88	12.8	2.69	12.4	2.60	12.0	2.51	11.2	2.32

4TW32032-2

#### NOTES - ANMERKUNGEN - Σημειώσεις - NOTAS - REMARQUES - NOTE - OPMERKINGEN - примечания - NOTLAR

- is shown as reference  
When selecting the unit models, avoid the outdoor air temperature range shown by ■  
■ dient als Verweis.  
Vermeiden Sie bei der Auswahl der Gerätemodelle den als ■ markierten Temperaturbereich der Außenluft.  
■ εμφανίζεται σαν τιμή αναφοράς.  
Κατά την επιλογή μοντέλων μονάδων, αποφύγετε την περιοχή θερμοκρασίας εξωτερικού αέρα που εμφανίζεται στο. ■  
■ se muestra a modo de referencia.  
Cuando seleccione los modelos de unidad, evite el intervalo de temperaturas del aire exterior indicado mediante ■  
■ est indiqué à titre de référence.  
Lors de la sélection des modèles d'unité, évitez la plage de température d'air extérieur repérée par ■  
■ viene mostrato come riferimento.  
Nel selezionare i modelli delle unità, non considerare i valori di temperatura dell'aria esterna indicati con il colore ■  
■ wordt ter referentie opgegeven  
Bij selectie van de modellen dient u het gemarkeerde ■ bereik voor de buitenluchttemperatuur te vermijden.  
■ приведено для справки  
При выборе моделей блоков избегайте диапазон температура наружного воздуха, показанный в ■
- referans olarak görülmektedir.  
Ünite modellerini seçerken, görülen dış hava sıcaklığı aralığından kaçının ■  
The above table shows the average value of conditions which may occur.  
Die obige Tabelle zeigt den Durchschnittswert der Bedingungen, die auftreten können.  
Στον παραπάνω πίνακα αναγράφεται η μέση τιμή για συνθήκες που μπορεί να προκύψουν.  
La tabla de arriba muestra el valor medio de condiciones que pueden ocurrir.  
Le tableau ci-dessus donne la valeur moyenne pour des conditions qui peuvent survenir.  
La tabella in alto mostra il valore delle condizioni medie che si possono riscontrare.  
De tabel hierboven geeft de gemiddelde waarde aan van situaties die kunnen voorvallen.  
Таблица расположенная выше показывает среднее значение условий, которые могут наступить.  
Yukarıdaki tablo meydana gelebilecek koşulların ortalama değerini göstermektedir.



# 5 Capacity tables

## 5 - 2 Heating Capacity Tables

### ERQ125AW1

Heating

TC: Total capacity; kW; PI: Power Input; kW (Comp. + Outdoor fan motor)

Combination % kW (Capacity index)	Outdoor air temp.		Indoor air temp. °CWB											
	°CDB	°CWB	16.0		18.0		20.0		21.0		22.0		24.0	
			TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
70% 9.80 kW (88)	-19.8	-20.0	10.3	4.39	10.2	4.49	10.2	4.60	10.2	4.65	10.2	4.70	9.8	4.50
	-18.8	-19.0	10.6	4.45	10.6	4.55	10.5	4.65	10.5	4.70	10.5	4.73	9.8	4.33
	-16.7	-17.0	11.2	4.55	11.2	4.65	11.2	4.74	10.8	4.58	10.5	4.40	9.8	4.03
	-13.7	-15.0	11.8	4.65	11.8	4.74	11.2	4.46	10.8	4.28	10.5	4.11	9.8	3.78
	-11.8	-13.0	12.5	4.73	11.9	4.51	11.2	4.18	10.8	4.02	10.5	3.86	9.8	3.55
	-9.8	-11.0	12.6	4.56	11.9	4.24	11.2	3.94	10.8	3.79	10.5	3.64	9.8	3.35
	-9.5	-10.0	12.6	4.43	11.9	4.12	11.2	3.83	10.8	3.68	10.5	3.54	9.8	3.26
	-8.5	-9.1	12.6	4.31	11.9	4.02	11.2	3.73	10.8	3.59	10.5	3.45	9.8	3.18
	-7.0	-7.6	12.6	4.14	11.9	3.86	11.2	3.59	10.8	3.45	10.5	3.32	9.8	3.06
	-5.0	-5.6	12.6	3.93	11.9	3.67	11.2	3.41	10.8	3.28	10.5	3.16	9.8	2.92
	-3.0	-3.7	12.6	3.75	11.9	3.50	11.2	3.26	10.8	3.14	10.5	3.02	9.8	2.79
	0.0	-0.7	12.6	3.49	11.9	3.27	11.2	3.04	10.8	2.93	10.5	2.83	9.8	2.61
	3.0	2.2	12.6	3.28	11.9	3.07	11.2	2.86	10.8	2.76	10.5	2.66	9.8	2.47
	5.0	4.1	12.6	3.16	11.9	2.96	11.2	2.76	10.8	2.66	10.5	2.57	9.8	2.38
	7.0	6.0	12.6	3.04	11.9	2.85	11.2	2.66	10.8	2.57	10.5	2.48	9.8	2.30
	9.0	7.9	12.6	2.94	11.9	2.75	11.2	2.57	10.8	2.48	10.5	2.39	9.8	2.22
	11.0	9.8	12.6	2.84	11.9	2.66	11.2	2.49	10.8	2.40	10.5	2.32	9.8	2.15
	13.0	11.8	12.6	2.74	11.9	2.57	11.2	2.41	10.8	2.32	10.5	2.24	9.8	2.08
	15.0	13.7	12.6	2.66	11.9	2.49	11.2	2.33	10.8	2.25	10.5	2.18	9.8	2.02
60% 8.40 kW (75)	-19.8	-20.0	10.2	4.65	10.2	4.74	9.6	4.41	9.3	4.23	9.0	4.06	8.4	3.73
	-18.8	-19.0	10.5	4.70	10.2	4.58	9.6	4.24	9.3	4.08	9.0	3.92	8.4	3.60
	-16.7	-17.0	10.8	4.58	10.2	4.26	9.6	3.95	9.3	3.80	9.0	3.65	8.4	3.36
	-13.7	-15.0	10.8	4.28	10.2	3.99	9.6	3.70	9.3	3.56	9.0	3.43	8.4	3.16
	-11.8	-13.0	10.8	4.02	10.2	3.75	9.6	3.48	9.3	3.35	9.0	3.23	8.4	2.98
	-9.8	-11.0	10.8	3.79	10.2	3.53	9.6	3.29	9.3	3.17	9.0	3.05	8.4	2.82
	-9.5	-10.0	10.8	3.68	10.2	3.44	9.6	3.20	9.3	3.08	9.0	2.97	8.4	2.74
	-8.5	-9.1	10.8	3.59	10.2	3.35	9.6	3.12	9.3	3.01	9.0	2.90	8.4	2.68
	-7.0	-7.6	10.8	3.45	10.2	3.23	9.6	3.01	9.3	2.90	9.0	2.79	8.4	2.58
	-5.0	-5.6	10.8	3.28	10.2	3.07	9.6	2.86	9.3	2.76	9.0	2.66	8.4	2.46
	-3.0	-3.7	10.8	3.14	10.2	2.94	9.6	2.74	9.3	2.64	9.0	2.55	8.4	2.36
	0.0	-0.7	10.8	2.93	10.2	2.75	9.6	2.57	9.3	2.48	9.0	2.39	8.4	2.22
	3.0	2.2	10.8	2.76	10.2	2.59	9.6	2.42	9.3	2.34	9.0	2.26	8.4	2.10
	5.0	4.1	10.8	2.66	10.2	2.50	9.6	2.34	9.3	2.26	9.0	2.18	8.4	2.03
	7.0	6.0	10.8	2.57	10.2	2.41	9.6	2.26	9.3	2.18	9.0	2.11	8.4	1.96
	9.0	7.9	10.8	2.48	10.2	2.33	9.6	2.18	9.3	2.11	9.0	2.04	8.4	1.90
	11.0	9.8	10.8	2.40	10.2	2.26	9.6	2.12	9.3	2.05	9.0	1.98	8.4	1.84
	13.0	11.8	10.8	2.32	10.2	2.18	9.6	2.05	9.3	1.98	9.0	1.92	8.4	1.79
	15.0	13.7	10.8	2.25	10.2	2.12	9.6	1.99	9.3	1.93	9.0	1.86	8.4	1.74
50% 7.00 kW (63)	-19.8	-20.0	9.0	4.09	8.5	3.81	8.0	3.54	7.7	3.41	7.5	3.28	7.0	3.03
	-18.8	-19.0	9.0	3.94	8.5	3.68	8.0	3.42	7.7	3.29	7.5	3.17	7.0	2.92
	-16.7	-17.0	9.0	3.68	8.5	3.43	8.0	3.20	7.7	3.08	7.5	2.96	7.0	2.74
	-13.7	-15.0	9.0	3.45	8.5	3.22	8.0	3.00	7.7	2.89	7.5	2.79	7.0	2.58
	-11.8	-13.0	9.0	3.24	8.5	3.04	8.0	2.83	7.7	2.73	7.5	2.63	7.0	2.44
	-9.8	-11.0	9.0	3.07	8.5	2.87	8.0	2.68	7.7	2.59	7.5	2.49	7.0	2.31
	-9.5	-10.0	9.0	2.98	8.5	2.80	8.0	2.61	7.7	2.52	7.5	2.43	7.0	2.25
	-8.5	-9.1	9.0	2.91	8.5	2.73	8.0	2.55	7.7	2.46	7.5	2.38	7.0	2.21
	-7.0	-7.6	9.0	2.81	8.5	2.63	8.0	2.46	7.7	2.38	7.5	2.29	7.0	2.13
	-5.0	-5.6	9.0	2.68	8.5	2.51	8.0	2.35	7.7	2.27	7.5	2.19	7.0	2.04
	-3.0	-3.7	9.0	2.56	8.5	2.41	8.0	2.25	7.7	2.18	7.5	2.10	7.0	1.96
	0.0	-0.7	9.0	2.40	8.5	2.26	8.0	2.12	7.7	2.05	7.5	1.98	7.0	1.84
	3.0	2.2	9.0	2.27	8.5	2.14	8.0	2.00	7.7	1.94	7.5	1.87	7.0	1.75
	5.0	4.1	9.0	2.19	8.5	2.06	8.0	1.94	7.7	1.87	7.5	1.81	7.0	1.69
	7.0	6.0	9.0	2.12	8.5	1.99	8.0	1.87	7.7	1.81	7.5	1.76	7.0	1.64
	9.0	7.9	9.0	2.05	8.5	1.93	8.0	1.82	7.7	1.76	7.5	1.70	7.0	1.59
	11.0	9.8	9.0	1.99	8.5	1.87	8.0	1.76	7.7	1.71	7.5	1.65	7.0	1.55
	13.0	11.8	9.0	1.93	8.5	1.82	8.0	1.71	7.7	1.66	7.5	1.60	7.0	1.50
	15.0	13.7	9.0	1.87	8.5	1.77	8.0	1.66	7.7	1.61	7.5	1.56	7.0	1.46

4TW32032-2

# 5 Capacity tables

## 5 - 2 Heating Capacity Tables

### ERQ200AW1

#### Heating

TC: Total capacity; kW; PI: Power Input; kW (Comp. + Outdoor fan motor)

Combination % kW (Capacity index)	Outdoor air temp.		Indoor air temp. °CWB															
			16.0		18.0		20.0		21.0		22.0		24.0					
			TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
100% 22.40 kW (200)	°CDB	°CWB	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
	-19.8	-20.0	16.0	4.84	16.0	5.05	15.9	5.26	15.9	5.36	15.9	5.46	15.8	5.67				
	-18.8	-19.0	16.5	4.96	16.4	5.16	16.4	5.36	16.4	5.46	16.3	5.56	16.3	5.75				
	-16.7	-17.0	17.4	5.16	17.4	5.35	17.4	5.54	17.3	5.63	17.3	5.73	17.3	5.92				
	-13.7	-15.0	18.4	5.35	18.4	5.53	18.3	5.70	18.3	5.79	18.3	5.88	18.2	6.06				
	-11.8	-13.0	19.4	5.51	19.3	5.68	19.3	5.85	19.3	5.94	19.2	6.02	19.2	6.19				
	-9.8	-11.0	20.3	5.66	20.3	5.82	20.2	5.99	20.2	6.07	20.2	6.15	20.1	6.31				
	-9.5	-10.0	20.8	5.73	20.8	5.89	20.7	6.05	20.7	6.13	20.7	6.20	20.6	6.36				
	-8.5	-9.1	21.2	5.79	21.2	5.95	21.1	6.10	21.1	6.18	21.1	6.25	21.1	6.41				
	-7.0	-7.6	22.0	5.89	21.9	6.04	21.9	6.19	21.8	6.26	21.8	6.33	21.8	6.48				
	-5.0	-5.6	22.9	6.01	22.9	6.15	22.8	6.29	22.8	6.36	22.8	6.43	21.8	6.15				
	-3.0	-3.7	23.8	6.11	23.8	6.25	23.7	6.38	23.7	6.45	23.4	6.39	21.8	5.86				
	0.0	-0.7	25.3	6.26	25.2	6.39	25.0	6.44	24.2	6.19	23.4	5.94	21.8	5.45				
	3.0	2.2	26.7	6.39	26.6	6.50	25.0	6.03	24.2	5.79	23.4	5.56	21.8	5.11				
	5.0	4.1	27.6	6.47	26.6	6.24	25.0	5.78	24.2	5.56	23.4	5.34	21.8	4.91				
90% 20.16 kW (180)	7.0	6.0	28.2	6.44	26.6	5.99	25.0	5.56	24.2	5.35	23.4	5.14	21.8	4.73				
	9.0	7.9	28.2	6.19	26.6	5.77	25.0	5.35	24.2	5.15	23.4	4.95	21.8	4.56				
	11.0	9.8	28.2	5.96	26.6	5.56	25.0	5.16	24.2	4.97	23.4	4.78	21.8	4.40				
	13.0	11.8	28.2	5.74	26.6	5.35	25.0	4.98	24.2	4.79	23.4	4.61	21.8	4.25				
	15.0	13.7	28.2	5.55	26.6	5.17	25.0	4.81	24.2	4.63	23.4	4.46	21.8	4.11				
	-19.8	-20.0	15.9	5.21	15.9	5.39	15.8	5.58	15.8	5.67	15.8	5.76	15.8	5.95				
	-18.8	-19.0	16.4	5.31	16.4	5.49	16.3	5.67	16.3	5.76	16.3	5.85	16.2	6.03				
	-16.7	-17.0	17.4	5.49	17.3	5.66	17.3	5.83	17.3	5.92	17.2	6.00	17.2	6.17				
	-13.7	-15.0	18.3	5.66	18.3	5.82	18.2	5.98	18.2	6.06	18.2	6.14	18.2	6.30				
	-11.8	-13.0	19.3	5.81	19.2	5.96	19.2	6.11	19.2	6.19	19.2	6.27	19.1	6.42				
	-9.8	-11.0	20.2	5.95	20.2	6.09	20.2	6.24	20.1	6.31	20.1	6.38	19.6	6.28				
	-9.5	-10.0	20.7	6.01	20.7	6.15	20.6	6.29	20.6	6.36	20.6	6.43	19.6	6.10				
	-8.5	-9.1	21.2	6.06	21.1	6.20	21.1	6.34	21.1	6.41	21.0	6.48	19.6	5.95				
	-7.0	-7.6	21.9	6.15	21.8	6.28	21.8	6.42	21.8	6.48	21.1	6.22	19.6	5.71				
	-5.0	-5.6	22.8	6.26	22.8	6.38	22.5	6.39	21.8	6.14	21.1	5.90	19.6	5.41				
80% 17.92 kW (160)	-3.0	-3.7	23.8	6.35	23.7	6.47	22.5	6.09	21.8	5.85	21.1	5.62	19.6	5.17				
	0.0	-0.7	25.2	6.49	23.9	6.11	22.5	5.67	21.8	5.45	21.1	5.24	19.6	4.82				
	3.0	2.2	25.4	6.14	23.9	5.72	22.5	5.31	21.8	5.11	21.1	4.91	19.6	4.53				
	5.0	4.1	25.4	5.89	23.9	5.49	22.5	5.10	21.8	4.91	21.1	4.72	19.6	4.35				
	7.0	6.0	25.4	5.66	23.9	5.28	22.5	4.91	21.8	4.73	21.1	4.55	19.6	4.20				
	9.0	7.9	25.4	5.45	23.9	5.09	22.5	4.73	21.8	4.56	21.1	4.39	19.6	4.05				
	11.0	9.8	25.4	5.26	23.9	4.91	22.5	4.57	21.8	4.40	21.1	4.24	19.6	3.91				
	13.0	11.8	25.4	5.07	23.9	4.73	22.5	4.41	21.8	4.25	21.1	4.09	19.6	3.78				
	15.0	13.7	25.4	4.90	23.9	4.58	22.5	4.27	21.8	4.11	21.1	3.96	19.6	3.66				
	-19.8	-20.0	15.8	5.57	15.8	5.73	15.8	5.90	15.8	5.98	15.7	6.06	15.7	6.22				
	-18.8	-19.0	16.3	5.66	16.3	5.82	16.3	5.98	16.2	6.06	16.2	6.14	16.2	6.30				
	-16.7	-17.0	17.3	5.82	17.2	5.97	17.2	6.12	17.2	6.20	17.2	6.28	17.1	6.43				
	-13.7	-15.0	18.2	5.97	18.2	6.11	18.2	6.26	18.2	6.33	18.1	6.40	17.4	6.16				
	-11.8	-13.0	19.2	6.11	19.2	6.24	19.1	6.38	19.1	6.44	18.7	6.31	17.4	5.78				
	-9.8	-11.0	20.2	6.23	20.1	6.36	20.0	6.44	19.4	6.18	18.7	5.93	17.4	5.45				
	-9.5	-10.0	20.6	6.28	20.6	6.41	20.0	6.25	19.4	6.00	18.7	5.76	17.4	5.29				
	-8.5	-9.1	21.1	6.33	21.0	6.46	20.0	6.09	19.4	5.85	18.7	5.62	17.4	5.16				
	-7.0	-7.6	21.8	6.41	21.3	6.30	20.0	5.84	19.4	5.62	18.7	5.40	17.4	4.96				
	-5.0	-5.6	22.6	6.42	21.3	5.98	20.0	5.54	19.4	5.33	18.7	5.12	17.4	4.72				
	-3.0	-3.7	22.6	6.11	21.3	5.70	20.0	5.29	19.4	5.09	18.7	4.89	17.4	4.51				
	0.0	-0.7	22.6	5.69	21.3	5.30	20.0	4.93	19.4	4.75	18.7	4.57	17.4	4.21				
	3.0	2.2	22.6	5.33	21.3	4.98	20.0	4.63	19.4	4.46	18.7	4.29	17.4	3.96				
	5.0	4.1	22.6	5.12	21.3	4.78	20.0	4.45	19.4	4.29	18.7	4.13	17.4	3.82				
	7.0	6.0	22.6	4.93	21.3	4.60	20.0	4.29	19.4	4.14	18.7	3.98	17.4	3.68				
	9.0	7.9	22.6	4.75	21.3	4.44	20.0	4.14	19.4	3.99	18.7	3.85	17.4	3.56				
	11.0	9.8	22.6	4.58	21.3	4.29	20.0	4.00	19.4	3.86	18.7	3.72	17.4	3.44				
	13.0	11.8	22.6	4.42	21.3	4.14	20.0	3.86	19.4	3.73	18.7	3.59	17.4	3.33				
	15.0	13.7	22.6	4.28	21.3	4.01	20.0	3.74	19.4	3.61	18.7	3.48	17.4	3.23				

4TW32032-2

#### NOTES - ANMERKUNGEN - Σημειώσεις - NOTAS - REMARQUES - NOTE - OPMERKINGEN - примечания - NOTLAR

- is shown as reference  
When selecting the unit models, avoid the outdoor air temperature range shown by ■  
■ dient als Verweis.  
Vermeiden Sie bei der Auswahl der Gerätemodelle den als ■ markierten Temperaturbereich der Außenluft.  
■ εμφανίζεται σαν τιμή αναφοράς.  
Κατά την επιλογή μοντέλων μονάδων, αποφύγετε την περιοχή θερμοκρασίας εξωτερικού αέρα που εμφανίζεται στο. ■  
■ se muestra a modo de referencia.  
Cuando seleccione los modelos de unidad, evite el intervalo de temperaturas del aire exterior indicado mediante ■  
■ est indiqué à titre de référence.  
Lors de la sélection des modèles d'unité, évitez la plage de température d'air extérieur repérée par ■  
■ viene mostrato come riferimento.  
Nel selezionare i modelli delle unità, non considerare i valori di temperatura dell'aria esterna indicati con il colore ■  
■ wordt ter referentie opgegeven  
Bij selectie van de modellen dient u het gemarkeerde ■ bereik voor de buitenluchttemperatuur te vermijden.  
■ приведено для справки  
При выборе моделей блоков избегайте диапазон температура наружного воздуха, показанный в ■
- referans olarak görülmektedir.  
Ünite modellerini seçerken, görülen dış hava sıcaklığı aralığından kaçının ■  
The above table shows the average value of conditions which may occur.  
Die obige Tabelle zeigt den Durchschnittswert der Bedingungen, die auftreten können.  
Στον παραπάνω πίνακα αναγράφεται η μέση τιμή για συνθήκες που μπορεί να προκύψουν.  
La tabla de arriba muestra el valor medio de condiciones que pueden ocurrir.  
Le tableau ci-dessus donne la valeur moyenne pour des conditions qui peuvent survenir.  
La tabella in alto mostra il valore delle condizioni medie che si possono riscontrare.  
De tabel hierboven geeft de gemiddelde waarde aan van situaties die kunnen voorvallen.  
Таблица расположенная выше показывает среднее значение условий, которые могут наступить.  
Yukarıdaki tablo meydana gelebilecek koşulların ortalama değerini göstermektedir.



# 5 Capacity tables

## 5 - 2 Heating Capacity Tables

### ERQ200AW1

Heating

TC: Total capacity; kW; PI: Power Input; kW (Comp. + Outdoor fan motor)

Combination % kW (Capacity index)	Outdoor air temp.		Indoor air temp. °CWB											
			16.0		18.0		20.0		21.0		22.0		24.0	
			TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
70% 15.68 kW (140)	°CDB	°CWB	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
	-19.8	-20.0	15.8	5.93	15.7	6.07	15.7	6.22	15.7	6.29	15.7	6.36	15.3	6.25
	-18.8	-19.0	16.2	6.01	16.2	6.15	16.2	6.29	16.2	6.36	16.2	6.43	15.3	6.02
	-16.7	-17.0	17.2	6.15	17.2	6.29	17.1	6.42	16.9	6.37	16.4	6.11	15.3	5.61
	-13.7	-15.0	18.2	6.28	18.1	6.41	17.5	6.19	16.9	5.95	16.4	5.71	15.3	5.25
	-11.8	-13.0	19.1	6.40	18.6	6.27	17.5	5.81	16.9	5.59	16.4	5.37	15.3	4.93
	-9.8	-11.0	19.7	6.34	18.6	5.90	17.5	5.47	16.9	5.27	16.4	5.06	15.3	4.66
	-9.5	-10.0	19.7	6.15	18.6	5.73	17.5	5.32	16.9	5.12	16.4	4.92	15.3	4.53
	-8.5	-9.1	19.7	6.00	18.6	5.59	17.5	5.19	16.9	4.99	16.4	4.80	15.3	4.42
	-7.0	-7.6	19.7	5.75	18.6	5.36	17.5	4.99	16.9	4.80	16.4	4.62	15.3	4.26
	-5.0	-5.6	19.7	5.46	18.6	5.09	17.5	4.74	16.9	4.56	16.4	4.39	15.3	4.05
	-3.0	-3.7	19.7	5.21	18.6	4.86	17.5	4.53	16.9	4.36	16.4	4.20	15.3	3.88
	0.0	-0.7	19.7	4.86	18.6	4.54	17.5	4.23	16.9	4.08	16.4	3.93	15.3	3.63
	3.0	2.2	19.7	4.56	18.6	4.27	17.5	3.98	16.9	3.84	16.4	3.70	15.3	3.43
	5.0	4.1	19.7	4.39	18.6	4.11	17.5	3.83	16.9	3.70	16.4	3.57	15.3	3.30
	7.0	6.0	19.7	4.23	18.6	3.96	17.5	3.70	16.9	3.57	16.4	3.44	15.3	3.19
	9.0	7.9	19.7	4.08	18.6	3.82	17.5	3.57	16.9	3.45	16.4	3.33	15.3	3.09
	11.0	9.8	19.7	3.94	18.6	3.70	17.5	3.46	16.9	3.34	16.4	3.22	15.3	2.99
	13.0	11.8	19.7	3.81	18.6	3.57	17.5	3.34	16.9	3.23	16.4	3.12	15.3	2.90
	15.0	13.7	19.7	3.69	18.6	3.47	17.5	3.24	16.9	3.13	16.4	3.03	15.3	2.81
60% 13.44 kW (120)	-19.8	-20.0	15.7	6.29	15.7	6.41	15.0	6.12	14.5	5.88	14.0	5.65	13.1	5.19
	-18.8	-19.0	16.2	6.36	16.0	6.36	15.0	5.90	14.5	5.67	14.0	5.45	13.1	5.01
	-16.7	-17.0	16.9	6.36	16.0	5.92	15.0	5.50	14.5	5.29	14.0	5.08	13.1	4.68
	-13.7	-15.0	16.9	5.95	16.0	5.54	15.0	5.15	14.5	4.95	14.0	4.76	13.1	4.39
	-11.8	-13.0	16.9	5.58	16.0	5.21	15.0	4.84	14.5	4.66	14.0	4.48	13.1	4.14
	-9.8	-11.0	16.9	5.26	16.0	4.91	15.0	4.57	14.5	4.40	14.0	4.24	13.1	3.91
	-9.5	-10.0	16.9	5.12	16.0	4.78	15.0	4.45	14.5	4.28	14.0	4.13	13.1	3.81
	-8.5	-9.1	16.9	4.99	16.0	4.66	15.0	4.34	14.5	4.18	14.0	4.03	13.1	3.72
	-7.0	-7.6	16.9	4.80	16.0	4.48	15.0	4.18	14.5	4.03	14.0	3.88	13.1	3.59
	-5.0	-5.6	16.9	4.56	16.0	4.27	15.0	3.98	14.5	3.84	14.0	3.70	13.1	3.42
	-3.0	-3.7	16.9	4.36	16.0	4.08	15.0	3.81	14.5	3.67	14.0	3.54	13.1	3.28
	0.0	-0.7	16.9	4.08	16.0	3.82	15.0	3.57	14.5	3.44	14.0	3.32	13.1	3.08
	3.0	2.2	16.9	3.84	16.0	3.60	15.0	3.37	14.5	3.25	14.0	3.14	13.1	2.92
	5.0	4.1	16.9	3.70	16.0	3.47	15.0	3.25	14.5	3.14	14.0	3.03	13.1	2.82
	7.0	6.0	16.9	3.57	16.0	3.35	15.0	3.14	14.5	3.03	14.0	2.93	13.1	2.72
	9.0	7.9	16.9	3.45	16.0	3.24	15.0	3.04	14.5	2.93	14.0	2.84	13.1	2.64
	11.0	9.8	16.9	3.34	16.0	3.14	15.0	2.94	14.5	2.84	14.0	2.75	13.1	2.56
	13.0	11.8	16.9	3.23	16.0	3.04	15.0	2.85	14.5	2.76	14.0	2.66	13.1	2.48
	15.0	13.7	16.9	3.13	16.0	2.95	15.0	2.77	14.5	2.68	14.0	2.59	13.1	2.41
50% 11.20 kW (100)	-19.8	-20.0	14.1	5.68	13.3	5.30	12.5	4.93	12.1	4.74	11.7	4.56	10.9	4.21
	-18.8	-19.0	14.1	5.48	13.3	5.11	12.5	4.75	12.1	4.58	11.7	4.40	10.9	4.06
	-16.7	-17.0	14.1	5.11	13.3	4.77	12.5	4.44	12.1	4.28	11.7	4.12	10.9	3.81
	-13.7	-15.0	14.1	4.79	13.3	4.48	12.5	4.17	12.1	4.02	11.7	3.87	10.9	3.58
	-11.8	-13.0	14.1	4.51	13.3	4.22	12.5	3.94	12.1	3.80	11.7	3.66	10.9	3.39
	-9.8	-11.0	14.1	4.26	13.3	3.99	12.5	3.73	12.1	3.60	11.7	3.47	10.9	3.21
	-9.5	-10.0	14.1	4.15	13.3	3.89	12.5	3.63	12.1	3.50	11.7	3.38	10.9	3.13
	-8.5	-9.1	14.1	4.05	13.3	3.80	12.5	3.55	12.1	3.43	11.7	3.30	10.9	3.07
	-7.0	-7.6	14.1	3.90	13.3	3.66	12.5	3.42	12.1	3.30	11.7	3.19	10.9	2.96
	-5.0	-5.6	14.1	3.72	13.3	3.49	12.5	3.26	12.1	3.15	11.7	3.05	10.9	2.83
	-3.0	-3.7	14.1	3.56	13.3	3.34	12.5	3.13	12.1	3.03	11.7	2.92	10.9	2.72
	0.0	-0.7	14.1	3.34	13.3	3.14	12.5	2.94	12.1	2.85	11.7	2.75	10.9	2.56
	3.0	2.2	14.1	3.15	13.3	2.97	12.5	2.79	12.1	2.70	11.7	2.61	10.9	2.43
	5.0	4.1	14.1	3.05	13.3	2.87	12.5	2.69	12.1	2.61	11.7	2.52	10.9	2.35
	7.0	6.0	14.1	2.94	13.3	2.77	12.5	2.61	12.1	2.52	11.7	2.44	10.9	2.28
	9.0	7.9	14.1	2.85	13.3	2.69	12.5	2.52	12.1	2.45	11.7	2.37	10.9	2.21
	11.0	9.8	14.1	2.76	13.3	2.61	12.5	2.45	12.1	2.37	11.7	2.30	10.9	2.15
	13.0	11.8	14.1	2.68	13.3	2.53	12.5	2.38	12.1	2.30	11.7	2.23	10.9	2.09
	15.0	13.7	14.1	2.60	13.3	2.46	12.5	2.31	12.1	2.24	11.7	2.17	10.9	2.03

4TW32032-2

## 5 Capacity tables

### 5 - 2 Heating Capacity Tables

#### ERQ250AW1

##### Heating

TC: Total capacity; kW; PI: Power Input; kW (Comp. + Outdoor fan motor)

Combination % kW (Capacity index)	Outdoor air temp.		Indoor air temp. °CWB											
			16.0		18.0		20.0		21.0		22.0		24.0	
			TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
70% 19.60 kW (175)	°CDB	°CWB	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
	-19.8	-20.0	19.8	8.56	19.7	8.76	19.7	8.97	19.7	9.07	19.7	9.18	19.2	9.08
	-18.8	-19.0	20.1	8.63	20.1	8.83	20.0	9.03	20.0	9.13	20.0	9.24	19.2	8.89
	-16.7	-17.0	20.9	8.77	20.9	8.97	20.8	9.16	20.8	9.26	20.6	9.25	19.2	8.48
	-13.7	-15.0	21.8	8.92	21.7	9.11	21.7	9.30	21.3	9.16	20.6	8.79	19.2	8.06
	-11.8	-13.0	22.7	9.07	22.7	9.25	22.1	9.03	21.3	8.68	20.6	8.33	19.2	7.64
	-9.8	-11.0	23.8	9.22	23.5	9.21	22.1	8.53	21.3	8.20	20.6	7.87	19.2	7.23
	-9.5	-10.0	24.4	9.30	23.5	8.94	22.1	8.28	21.3	7.96	20.6	7.65	19.2	7.03
	-8.5	-9.1	24.9	9.35	23.5	8.70	22.1	8.06	21.3	7.75	20.6	7.45	19.2	6.85
	-7.0	-7.6	24.9	8.93	23.5	8.31	22.1	7.71	21.3	7.42	20.6	7.13	19.2	6.56
	-5.0	-5.6	24.9	8.39	23.5	7.82	22.1	7.26	21.3	6.98	20.6	6.71	19.2	6.19
	-3.0	-3.7	24.9	7.90	23.5	7.37	22.1	6.85	21.3	6.59	20.6	6.34	19.2	5.85
	0.0	-0.7	24.9	7.19	23.5	6.72	22.1	6.25	21.3	6.02	20.6	5.80	19.2	5.36
	3.0	2.2	24.9	6.57	23.5	6.15	22.1	5.73	21.3	5.52	20.6	5.32	19.2	4.92
	5.0	4.1	24.9	6.20	23.5	5.80	22.1	5.42	21.3	5.22	20.6	5.03	19.2	4.66
	7.0	6.0	24.9	5.86	23.5	5.49	22.1	5.12	21.3	4.94	20.6	4.77	19.2	4.42
	9.0	7.9	24.9	5.54	23.5	5.19	22.1	4.85	21.3	4.68	20.6	4.52	19.2	4.19
	11.0	9.8	24.9	5.24	23.5	4.91	22.1	4.60	21.3	4.44	20.6	4.29	19.2	3.98
	13.0	11.8	24.9	4.95	23.5	4.65	22.1	4.35	21.3	4.21	20.6	4.06	19.2	3.78
	15.0	13.7	24.9	4.69	23.5	4.41	22.1	4.13	21.3	4.00	20.6	3.86	19.2	3.60
60% 16.80 kW (150)	-19.8	-20.0	19.7	9.08	19.6	9.25	18.9	8.90	18.3	8.55	17.7	8.21	16.5	7.53
	-18.8	-19.0	20.0	9.14	20.0	9.31	18.9	8.71	18.3	8.37	17.7	8.03	16.5	7.37
	-16.7	-17.0	20.8	9.26	20.1	8.97	18.9	8.31	18.3	7.99	17.7	7.67	16.5	7.05
	-13.7	-15.0	21.3	9.16	20.1	8.82	18.9	7.90	18.3	7.60	17.7	7.30	16.5	6.71
	-11.8	-13.0	21.3	8.67	20.1	8.07	18.9	7.49	18.3	7.21	17.7	6.93	16.5	6.38
	-9.8	-11.0	21.3	8.19	20.1	7.63	18.9	7.09	18.3	6.82	17.7	6.56	16.5	6.05
	-9.5	-10.0	21.3	7.96	20.1	7.42	18.9	6.89	18.3	6.64	17.7	6.38	16.5	5.88
	-8.5	-9.1	21.3	7.75	20.1	7.23	18.9	6.72	18.3	6.47	17.7	6.22	16.5	5.74
	-7.0	-7.6	21.3	7.41	20.1	6.92	18.9	6.43	18.3	6.20	17.7	5.96	16.5	5.51
	-5.0	-5.6	21.3	6.98	20.1	6.52	18.9	6.07	18.3	5.85	17.7	5.63	16.5	5.21
	-3.0	-3.7	21.3	6.59	20.1	6.16	18.9	5.74	18.3	5.54	17.7	5.33	16.5	4.93
	0.0	-0.7	21.3	6.02	20.1	5.64	18.9	5.26	18.3	5.08	17.7	4.89	16.5	4.53
	3.0	2.2	21.3	5.52	20.1	5.18	18.9	4.84	18.3	4.67	17.7	4.51	16.5	4.18
	5.0	4.1	21.3	5.22	20.1	4.90	18.9	4.58	18.3	4.43	17.7	4.27	16.5	3.97
	7.0	6.0	21.3	4.94	20.1	4.64	18.9	4.34	18.3	4.20	17.7	4.06	16.5	3.77
	9.0	7.9	21.3	4.68	20.1	4.40	18.9	4.12	18.3	3.99	17.7	3.85	16.5	3.59
	11.0	9.8	21.3	4.44	20.1	4.18	18.9	3.92	18.3	3.79	17.7	3.66	16.5	3.42
	13.0	11.8	21.3	4.20	20.1	3.96	18.9	3.72	18.3	3.60	17.7	3.48	16.5	3.25
	15.0	13.7	21.3	4.00	20.1	3.76	18.9	3.54	18.3	3.43	17.7	3.32	16.5	3.10
50% 14.00 kW (125)	-19.8	-20.0	17.8	8.26	16.8	7.69	15.8	7.14	15.2	6.88	14.7	6.61	13.7	6.09
	-18.8	-19.0	17.8	8.08	16.8	7.53	15.8	7.00	15.2	6.73	14.7	6.47	13.7	5.97
	-16.7	-17.0	17.8	7.71	16.8	7.19	15.8	6.69	15.2	6.44	14.7	6.20	13.7	5.72
	-13.7	-15.0	17.8	7.34	16.8	6.85	15.8	6.37	15.2	6.14	14.7	5.91	13.7	5.46
	-11.8	-13.0	17.8	6.97	16.8	6.51	15.8	6.06	15.2	5.84	14.7	5.62	13.7	5.20
	-9.8	-11.0	17.8	6.60	16.8	6.17	15.8	5.75	15.2	5.54	14.7	5.34	13.7	4.94
	-9.5	-10.0	17.8	6.42	16.8	6.00	15.8	5.60	15.2	5.40	14.7	5.20	13.7	4.81
	-8.5	-9.1	17.8	6.26	16.8	5.86	15.8	5.46	15.2	5.27	14.7	5.08	13.7	4.70
	-7.0	-7.6	17.8	6.00	16.8	5.62	15.8	5.24	15.2	5.06	14.7	4.88	13.7	4.52
	-5.0	-5.6	17.8	5.66	16.8	5.31	15.8	4.96	15.2	4.79	14.7	4.62	13.7	4.28
	-3.0	-3.7	17.8	5.36	16.8	5.03	15.8	4.70	15.2	4.54	14.7	4.38	13.7	4.07
	0.0	-0.7	17.8	4.92	16.8	4.62	15.8	4.33	15.2	4.18	14.7	4.04	13.7	3.76
	3.0	2.2	17.8	4.53	16.8	4.26	15.8	3.99	15.2	3.86	14.7	3.73	13.7	3.48
	5.0	4.1	17.8	4.30	16.8	4.04	15.8	3.79	15.2	3.67	14.7	3.55	13.7	3.31
	7.0	6.0	17.8	4.08	16.8	3.84	15.8	3.61	15.2	3.49	14.7	3.38	13.7	3.16
	9.0	7.9	17.8	3.87	16.8	3.65	15.8	3.43	15.2	3.33	14.7	3.22	13.7	3.01
	11.0	9.8	17.8	3.68	16.8	3.47	15.8	3.27	15.2	3.17	14.7	3.07	13.7	2.87
	13.0	11.8	17.8	3.50	16.8	3.30	15.8	3.11	15.2	3.02	14.7	2.92	13.7	2.74
	15.0	13.7	17.8	3.33	16.8	3.15	15.8	2.97	15.2	2.88	14.7	2.79	13.7	2.62

4TW32032-2

#### NOTES - ANMERKUNGEN - Σημειώσεις - NOTAS - REMARQUES - NOTE - OPMERKINGEN - примечания - NOTLAR

- is shown as reference  
When selecting the unit models, avoid the outdoor air temperature range shown by ■  
■ dient als Verweis.  
Vermeiden Sie bei der Auswahl der Gerätemodelle den als ■ markierten Temperaturbereich der Außenluft.  
■ εμφανίζεται σαν τιμή αναφοράς.  
Κατά την επιλογή μοντέλων μονάδων, αποφύγετε την περιοχή θερμοκρασίας εξωτερικού αέρα που εμφανίζεται στο. ■  
■ se muestra a modo de referencia.  
Cuando seleccione los modelos de unidad, evite el intervalo de temperaturas del aire exterior indicado mediante ■  
■ est indiqué à titre de référence.  
Lors de la sélection des modèles d'unité, évitez la plage de température d'air extérieur repérée par ■  
■ viene mostrato come riferimento.  
Nel selezionare i modelli delle unità, non considerare i valori di temperatura dell'aria esterna indicati con il colore ■  
■ wordt ter referentie opgegeven  
Bij selectie van de modellen dient u het gemarkeerde ■ bereik voor de buitenluchttemperatuur te vermijden.  
■ приведено для справки  
При выборе моделей блоков избегайте диапазон температура наружного воздуха, показанный в ■
- referans olarak görülmektedir.  
Ünite modellerini seçerken, görülen dış hava sıcaklığı aralığından kaçının ■  
The above table shows the average value of conditions which may occur.  
Die obige Tabelle zeigt den Durchschnittswert der Bedingungen, die auftreten können.  
Στον παραπάνω πίνακα αναγράφεται η μέση τιμή για συνθήκες που μπορεί να προκύψουν.  
La tabla de arriba muestra el valor medio de condiciones que pueden ocurrir.  
Le tableau ci-dessus donne la valeur moyenne pour des conditions qui peuvent survenir.  
La tabella in alto mostra il valore delle condizioni medie che si possono riscontrare.  
De tabel hierboven geeft de gemiddelde waarde aan van situaties die kunnen voorvallen.  
Таблица расположенная выше показывает среднее значение условий, которые могут наступить.  
Yukarıdaki tablo meydana gelebilecek koşulların ortalama değerini göstermektedir.



# 5 Capacity tables

## 5 - 2 Heating Capacity Tables

### ERQ250AW1

Heating

TC: Total capacity; kW; PI: Power Input; kW (Comp. + Outdoor fan motor)

Combination % kW (Capacity index)	Outdoor air temp.		Indoor air temp. °CWB											
	°CDB	°CWB	16.0		18.0		20.0		21.0		22.0		24.0	
			TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
100% 28.00 kW (250)	-19.8	-20.0	20.1	7.00	20.0	7.29	20.0	7.59	19.9	7.74	19.9	7.88	19.8	8.18
	-18.8	-19.0	20.4	7.09	20.4	7.38	20.3	7.67	20.3	7.82	20.2	7.97	20.2	8.26
	-16.7	-17.0	21.2	7.29	21.1	7.57	21.1	7.85	21.0	7.99	21.0	8.13	21.0	8.41
	-13.7	-15.0	22.1	7.50	22.0	7.77	21.9	8.04	21.9	8.18	21.9	8.31	21.8	8.58
	-11.8	-13.0	23.0	7.72	23.0	7.97	22.9	8.23	22.9	8.36	22.9	8.49	22.8	8.75
	-9.8	-11.0	24.1	7.93	24.0	8.18	24.0	8.42	24.0	8.55	23.9	8.67	23.9	8.91
	-9.5	-10.0	24.7	8.04	24.6	8.28	24.6	8.52	24.5	8.64	24.5	8.76	24.4	9.00
	-8.5	-9.1	25.2	8.13	25.1	8.37	25.1	8.60	25.1	8.72	25.0	8.84	25.0	9.07
	-7.0	-7.6	26.1	8.29	26.1	8.52	26.0	8.74	26.0	8.86	26.0	8.97	25.9	9.20
	-5.0	-5.6	27.5	8.50	27.4	8.71	27.4	8.93	27.3	9.03	27.3	9.14	27.2	9.36
	-3.0	-3.7	28.8	8.69	28.8	8.89	28.7	9.10	28.7	9.20	28.7	9.30	27.5	8.91
	0.0	-0.7	31.1	8.97	31.1	9.16	31.0	9.35	30.5	9.20	29.5	8.82	27.5	8.09
	3.0	2.2	33.6	9.23	33.5	9.40	31.5	8.70	30.5	8.36	29.5	8.03	27.5	7.37
	5.0	4.1	35.3	9.40	33.5	8.83	31.5	8.18	30.5	7.87	29.5	7.56	27.5	6.95
	7.0	6.0	35.5	8.92	33.5	8.30	31.5	7.70	30.5	7.41	29.5	7.12	27.5	6.55
	9.0	7.9	35.5	8.38	33.5	7.81	31.5	7.25	30.5	6.98	29.5	6.71	27.5	6.18
	11.0	9.8	35.5	7.89	33.5	7.36	31.5	6.84	30.5	6.58	29.5	6.33	27.5	5.84
	13.0	11.8	35.5	7.41	33.5	6.92	31.5	6.44	30.5	6.20	29.5	5.97	27.5	5.51
	15.0	13.7	35.5	6.99	33.5	6.53	31.5	6.08	30.5	5.86	29.5	5.64	27.5	5.22
90% 25.20 kW (225)	-19.8	-20.0	20.0	7.52	19.9	7.78	19.9	8.05	19.8	8.18	19.8	8.32	19.8	8.58
	-18.8	-19.0	20.3	7.60	20.3	7.87	20.2	8.13	20.2	8.26	20.2	8.39	20.1	8.65
	-16.7	-17.0	21.1	7.79	21.0	8.04	21.0	8.29	21.0	8.42	20.9	8.54	20.9	8.79
	-13.7	-15.0	22.0	7.98	21.9	8.22	21.9	8.46	21.8	8.58	21.8	8.70	21.8	8.94
	-11.8	-13.0	22.9	8.17	22.9	8.40	22.8	8.63	22.8	8.75	22.8	8.86	22.7	9.09
	-9.8	-11.0	24.0	8.36	24.0	8.58	23.9	8.80	23.9	8.91	23.9	9.03	23.8	9.25
	-9.5	-10.0	24.6	8.46	24.5	8.68	24.5	8.89	24.4	9.00	24.4	9.11	24.4	9.32
	-8.5	-9.1	25.1	8.55	25.1	8.76	25.0	8.97	25.0	9.07	25.0	9.18	24.7	9.27
	-7.0	-7.6	26.0	8.69	26.0	8.89	25.9	9.10	25.9	9.20	25.9	9.30	24.7	8.85
	-5.0	-5.6	27.4	8.88	27.3	9.07	27.3	9.26	27.2	9.36	26.5	9.07	24.7	8.32
	-3.0	-3.7	28.7	9.05	28.7	9.23	28.4	9.27	27.4	8.90	26.5	8.54	24.7	7.84
	0.0	-0.7	31.1	9.31	30.2	9.08	28.4	8.41	27.4	8.08	26.5	7.76	24.7	7.13
	3.0	2.2	32.0	8.87	30.2	8.26	28.4	7.66	27.4	7.37	26.5	7.08	24.7	6.52
	5.0	4.1	32.0	8.34	30.2	7.77	28.4	7.22	27.4	6.94	26.5	6.68	24.7	6.15
	7.0	6.0	32.0	7.84	30.2	7.32	28.4	6.80	27.4	6.55	26.5	6.30	24.7	5.81
	9.0	7.9	32.0	7.39	30.2	6.89	28.4	6.41	27.4	6.18	26.5	5.95	24.7	5.49
	11.0	9.8	32.0	6.96	30.2	6.50	28.4	6.06	27.4	5.84	26.5	5.62	24.7	5.20
	13.0	11.8	32.0	6.55	30.2	6.13	28.4	5.71	27.4	5.51	26.5	5.31	24.7	4.91
	15.0	13.7	32.0	6.19	30.2	5.79	28.4	5.41	27.4	5.22	26.5	5.03	24.7	4.66
80% 22.40 kW (200)	-19.8	-20.0	19.9	8.04	19.8	8.27	19.8	8.51	19.8	8.63	19.7	8.75	19.7	8.98
	-18.8	-19.0	20.2	8.11	20.2	8.35	20.1	8.58	20.1	8.70	20.1	8.81	20.0	9.05
	-16.7	-17.0	21.0	8.28	20.9	8.50	20.9	8.73	20.9	8.84	20.9	8.95	20.8	9.17
	-13.7	-15.0	21.9	8.45	21.8	8.66	21.8	8.88	21.8	8.98	21.7	9.09	21.7	9.31
	-11.8	-13.0	22.8	8.62	22.8	8.83	22.7	9.03	22.7	9.13	22.7	9.24	22.0	8.99
	-9.8	-11.0	23.9	8.79	23.9	8.99	23.8	9.19	23.8	9.28	23.6	9.26	22.0	8.49
	-9.5	-10.0	24.5	8.88	24.4	9.07	24.4	9.26	24.4	9.36	23.6	8.99	22.0	8.24
	-8.5	-9.1	25.0	8.96	25.0	9.15	24.9	9.33	24.4	9.12	23.6	8.75	22.0	8.02
	-7.0	-7.6	25.9	9.09	25.9	9.27	25.2	9.07	24.4	8.71	23.6	8.36	22.0	7.67
	-5.0	-5.6	27.3	9.25	26.8	9.20	25.2	8.52	24.4	8.19	23.6	7.86	22.0	7.22
	-3.0	-3.7	28.4	9.30	26.8	8.66	25.2	8.02	24.4	7.72	23.6	7.41	22.0	6.82
	0.0	-0.7	28.4	8.44	26.8	7.86	25.2	7.30	24.4	7.03	23.6	6.75	22.0	6.22
	3.0	2.2	28.4	7.69	26.8	7.17	25.2	6.67	24.4	6.42	23.6	6.18	22.0	5.70
	5.0	4.1	28.4	7.24	26.8	6.76	25.2	6.29	24.4	6.06	23.6	5.84	22.0	5.39
	7.0	6.0	28.4	6.82	26.8	6.38	25.2	5.94	24.4	5.73	23.6	5.52	22.0	5.10
	9.0	7.9	28.4	6.44	26.8	6.02	25.2	5.61	24.4	5.41	23.6	5.22	22.0	4.83
	11.0	9.8	28.4	6.08	26.8	5.69	25.2	5.31	24.4	5.12	23.6	4.94	22.0	4.58
	13.0	11.8	28.4	5.73	26.8	5.37	25.2	5.02	24.4	4.84	23.6	4.67	22.0	4.33
	15.0	13.7	28.4	5.42	26.8	5.09	25.2	4.76	24.4	4.59	23.6	4.43	22.0	4.12

4TW32032-2

## 5 Capacity tables

### 5 - 3 Integrated Heating Capacity Correction Factor

#### ERQ-AW1

##### Integrated heating capacity coefficient

The heating capacity tables do not take account of the reduction in capacity, when frost has accumulated or while the defrosting operation is in progress. The capacity values, which take these factors into account, in other words, the integrated heating capacity values, can be calculated as follows

Formula:

Integrated heating capacity = A


Value given in table of capacity characteristics = B

Integrating correction factor for frost accumulation (kW) = C

$A = B \times C$

Correction factor for finding integrated heating capacity

Inlet port temperature of heat exchanger (°C/RH 85%)	-7	-5	-3	0	3	5	7
Integrating correction factor for frost accumulation	0,96	0,93	0,87	0,81	0,83	0,89	1,0

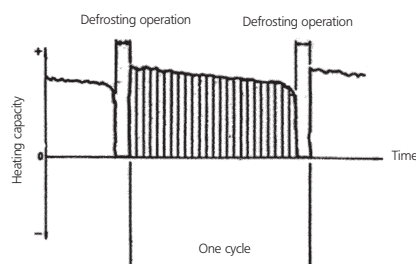

Note:

1. The figures shows that the integrated heating capacity expresses the integrated capacity for a single cycle (from defrost operation to defrost operation) in terms of time.

Please note that, when there is an accumulation of snow against the outside surface of the outdoor unit heat exchanger, there will always be a temporary reduction in capacity, although this will of course vary in degree in accordance with a number of other factors, such as the outdoor temperature (°CDB), relative humidity (RH) and the amount of frosting which occurs.




3TW27232-7

# 5 Capacity tables


## 5 - 4 Capacity Correction Factor

### ERQ-AW1

Correction factor for piping length ( $\alpha$ )  
Cooling

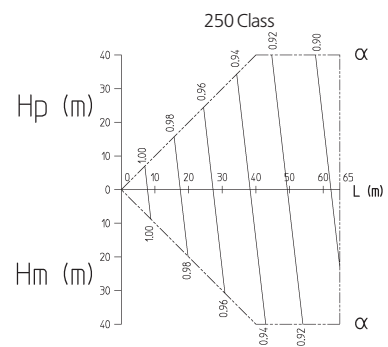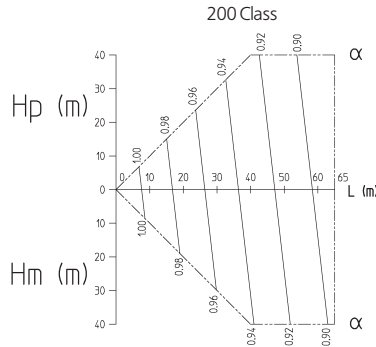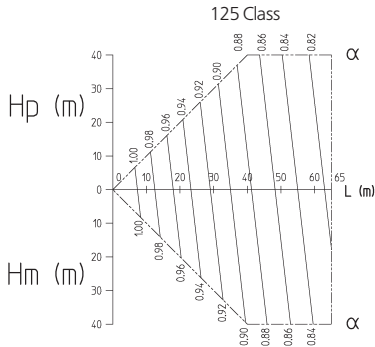

Correction factor for piping length ( $\alpha$ )  
Heating

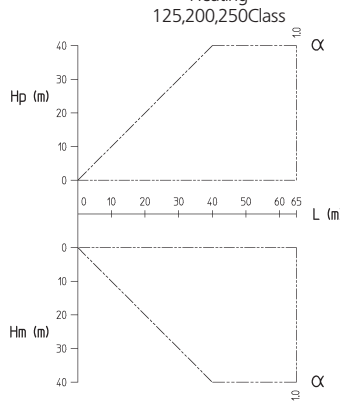

#### Explanation of symbols:

Hp: Level difference between air handling unit and outdoor unit when air handling unit is installed below the outdoor unit  
Hm: Level difference between air handling unit and outdoor unit when air handling unit is installed above the outdoor unit  
L: Equivalent piping length (m)  
 $\alpha$ : Capacity correction factor

#### Diameter of pipes:

Outdoor unit class	Gas	Liquid
125	$\phi$ 15.9	$\phi$ 9.5
200	$\phi$ 19.1	$\phi$ 9.5
250	$\phi$ 22.2	$\phi$ 9.5

#### Notes:


- These figures illustrate the correction factor for piping length of the system at maximum load under standard conditions.  
Under partial load conditions there is only minor deviation from the correction factor shown in the figures above.
- Method of calculating cooling capacity (max. capacity)  
Cooling capacity = Cooling capacity obtained from the cooling capacity characteristics table X Capacity correction factor
- Method of calculating heating capacity (max. capacity)  
Heating capacity = Heating capacity obtained from the heating capacity characteristics table X Capacity correction factor

3TW32032-2

## 6 Dimensional drawings


### 6 - 1 Dimensional Drawings

#### ERQ125AW1

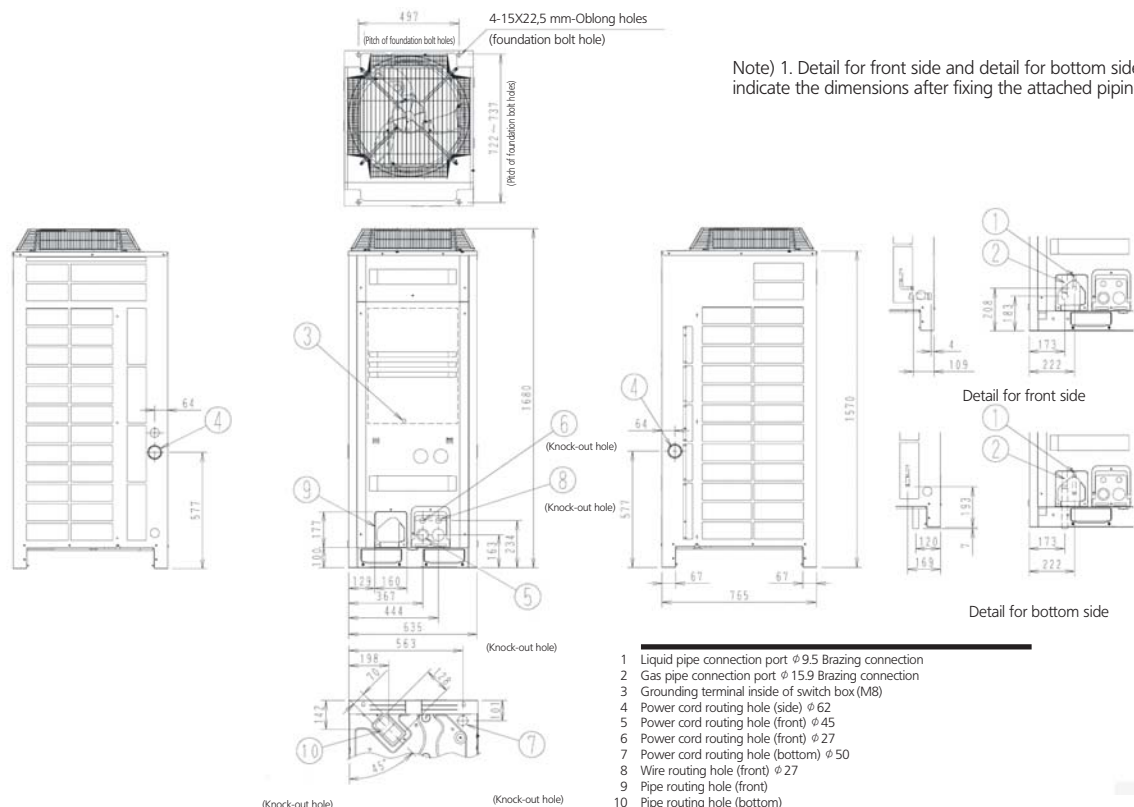

3D051448F

#### ERQ200,250AW1

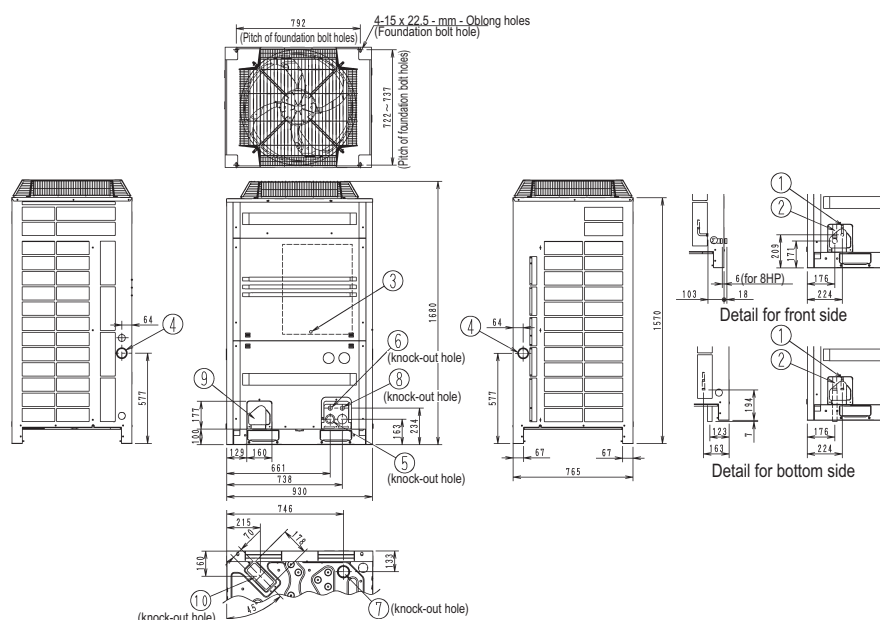

3D051449N

No.	Parts name	Remarks
1	Liquid pipe connection port	See note 2
2	Gas pipe connection port	See note 2
3	Grounding terminal	Inside of switch box (M8)
4	Power cord routing hole (side)	$\phi$ 62
5	Power cord routing hole (front)	$\phi$ 45
6	Power cord routing hole (front)	$\phi$ 27
7	Power cord routing hole (bottom)	$\phi$ 66.5
8	Wire routing hole (front)	$\phi$ 27
9	Pipe routing hole (front)	
10	Pipe routing hole (bottom)	

#### NOTES

- Detail for front side and detail for bottom side indicate the dimensions after fixing the attached piping.
- Gas pipe (Heat pump type)  
 $\phi$  19.1 Brazing connection  
 $\phi$  22.2 Brazing connection  
Liquid pipe (Heat pump type)  
 $\phi$  9.5 Brazing connection




## 6 Dimensional drawings

### 6 - 2 Dimensional Drawings with Accessories

6


ERQ125AW1

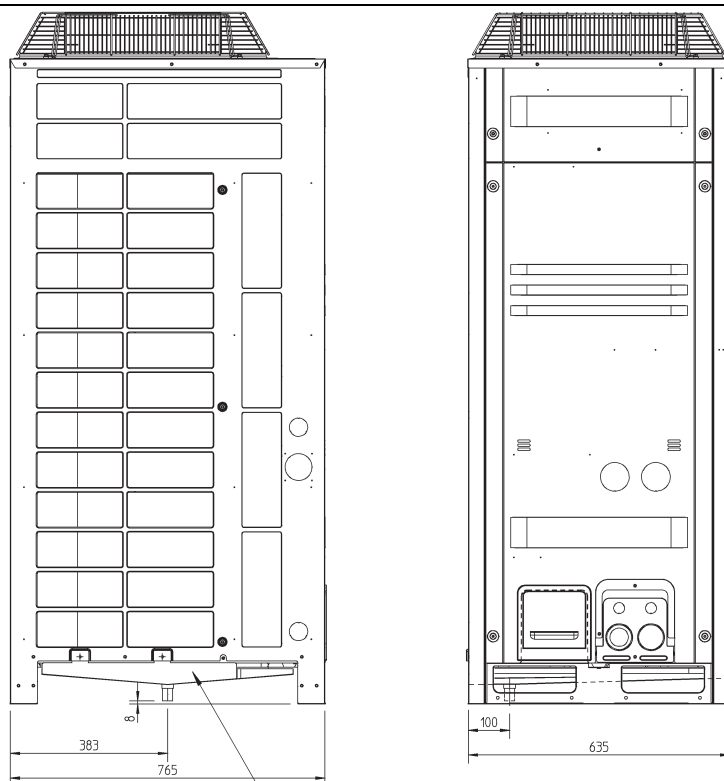

① Central drain pan kit (KWC26B160)

3TW27234-1

ERQ200,250AW1

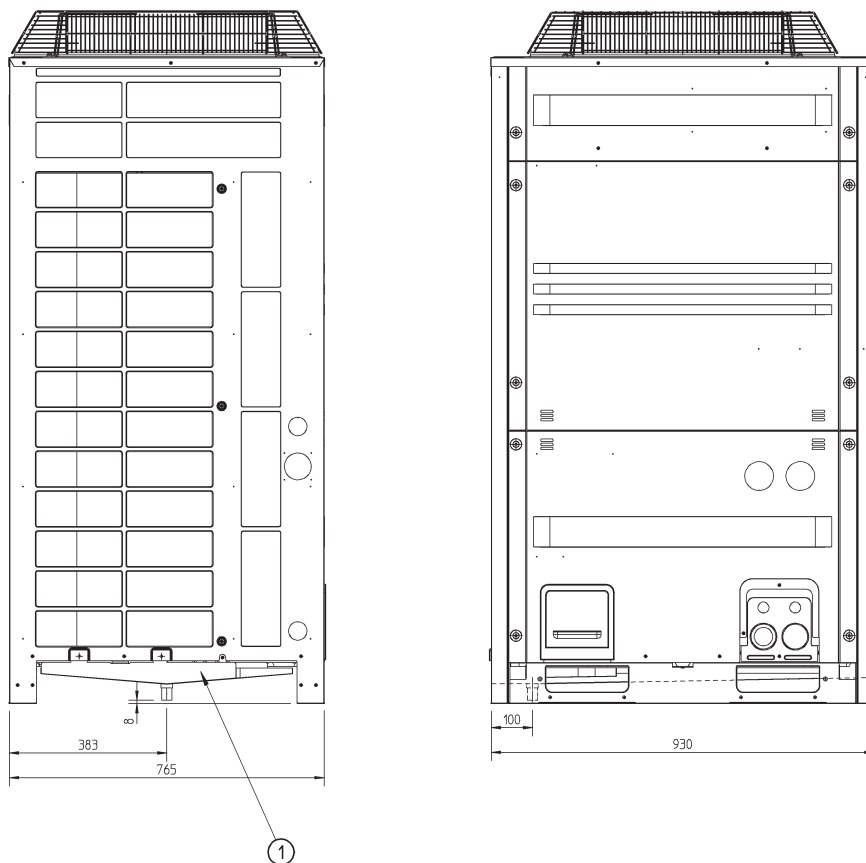

①


3TW27244-1

## 7 Centre of gravity

### 7 - 1 Centre of Gravity


7

ERQ125AW1

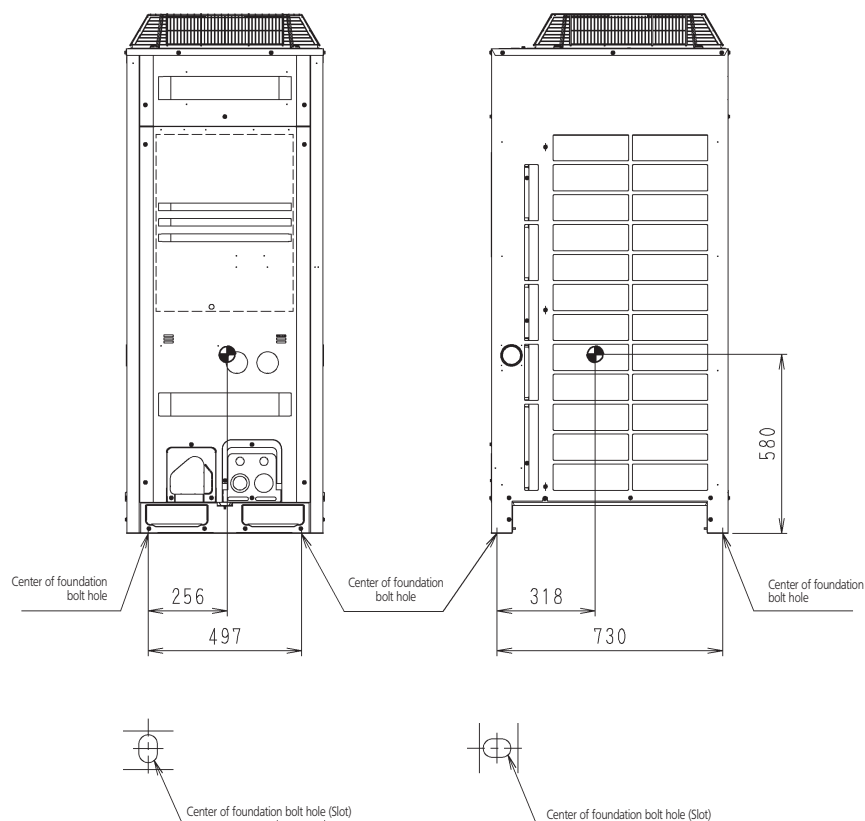

4D052145E

ERQ200AW1

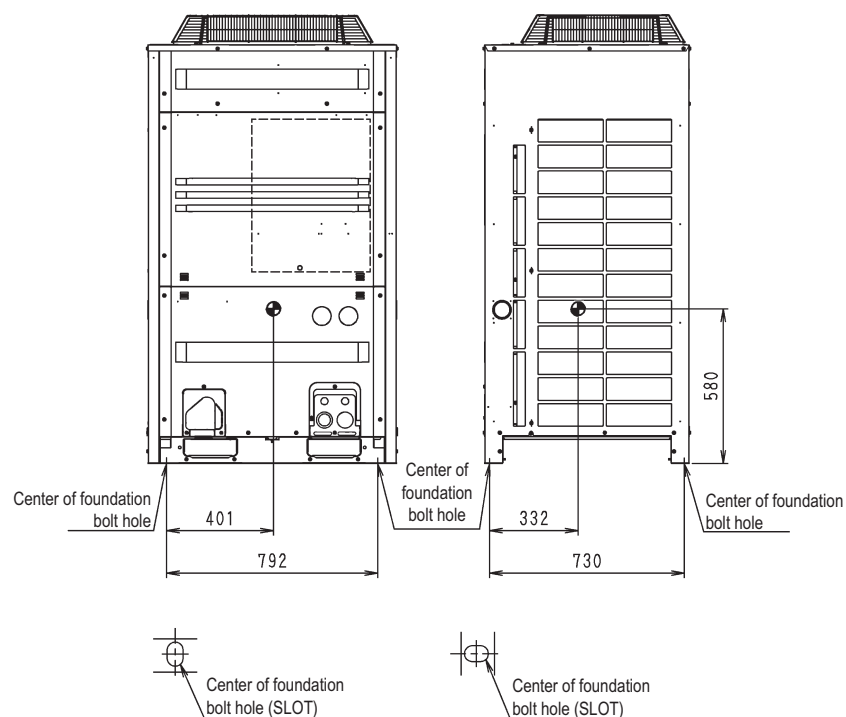


4D052146P

## 7 Centre of gravity

### 7 - 1 Centre of Gravity

ERQ250AW1

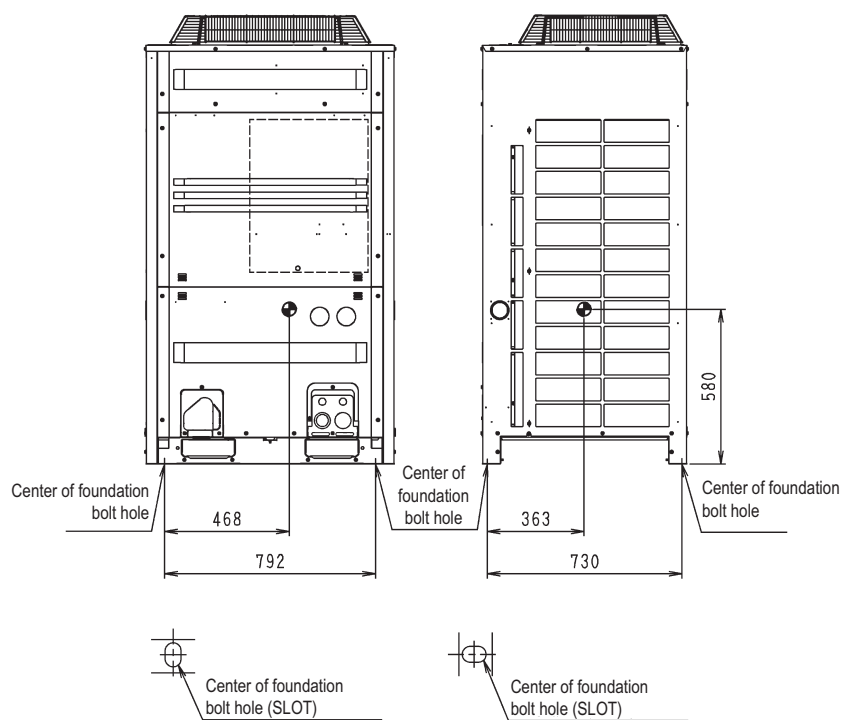


4D052147N

## 8 Piping diagrams

### 8 - 1 Piping Diagrams

ERQ125AW1

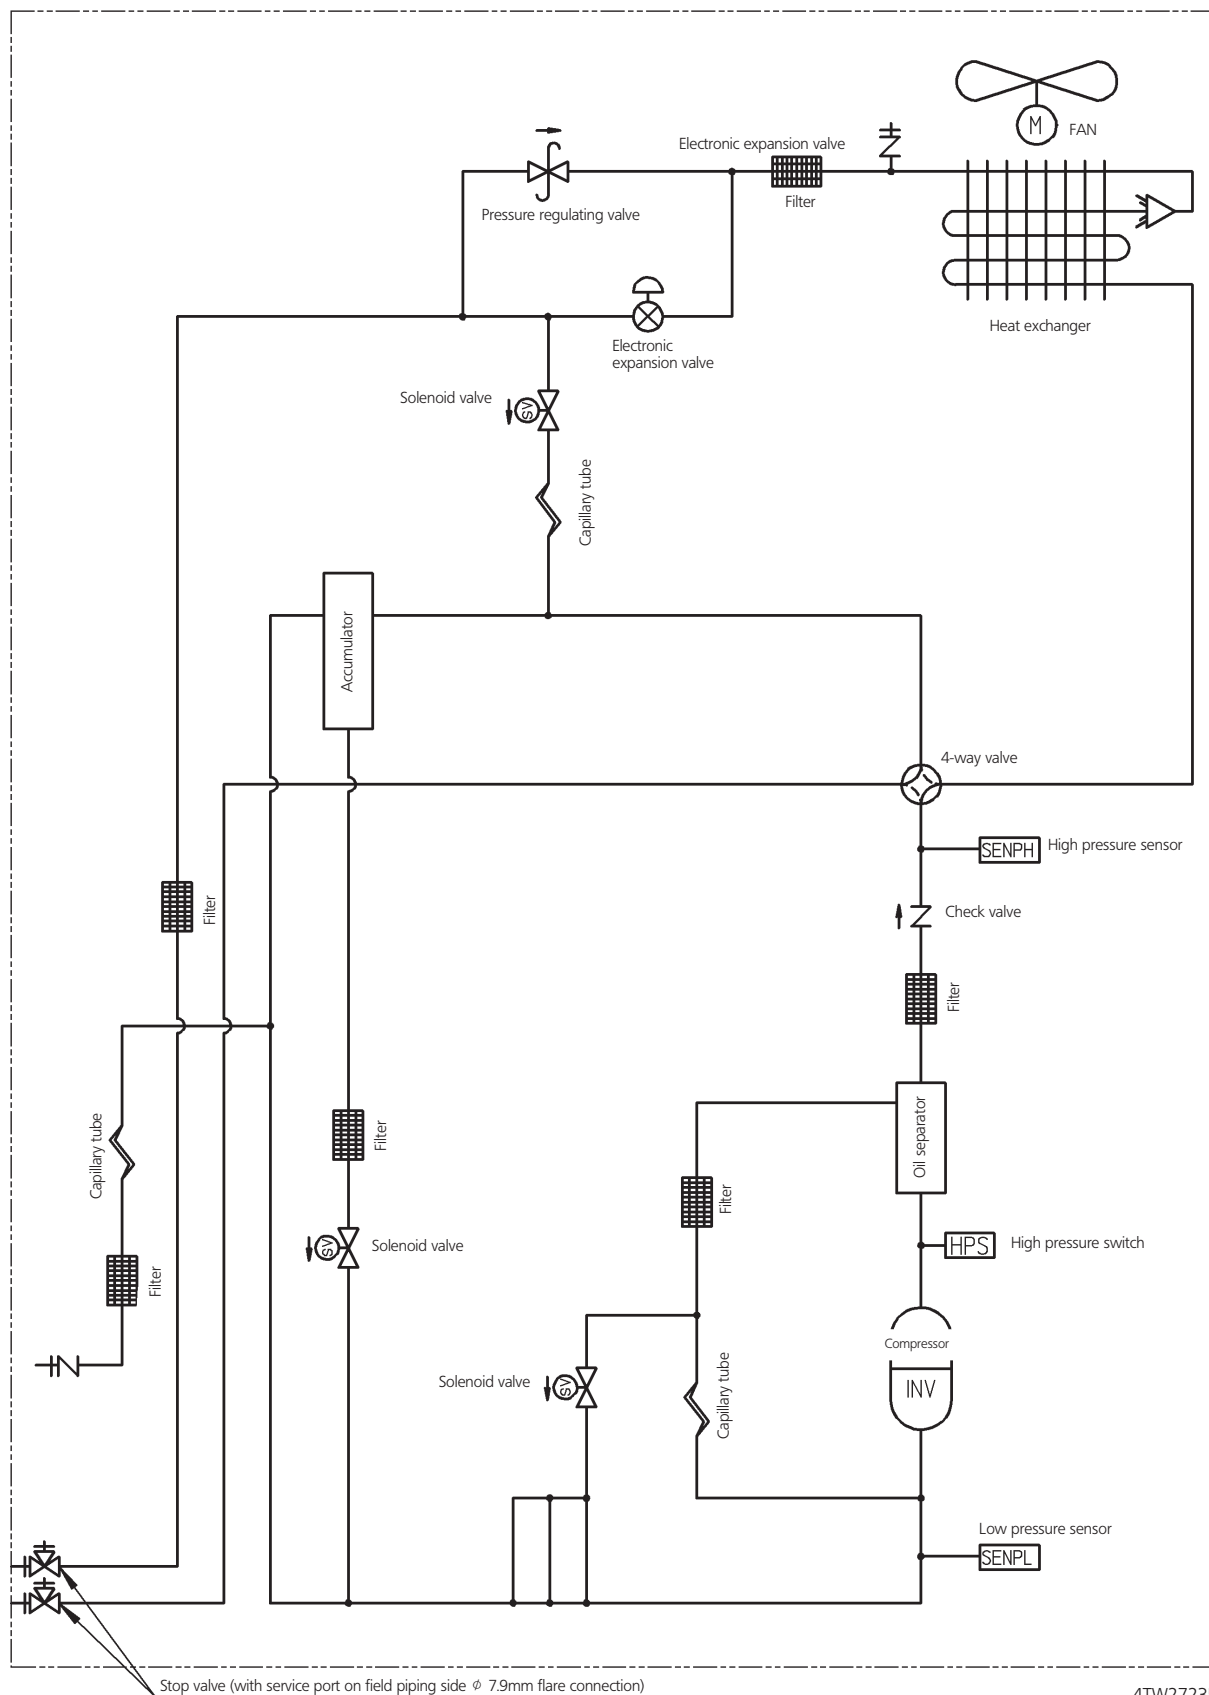


4TW27235-1

## 8 Piping diagrams

### 8 - 1 Piping Diagrams

ERQ200AW1

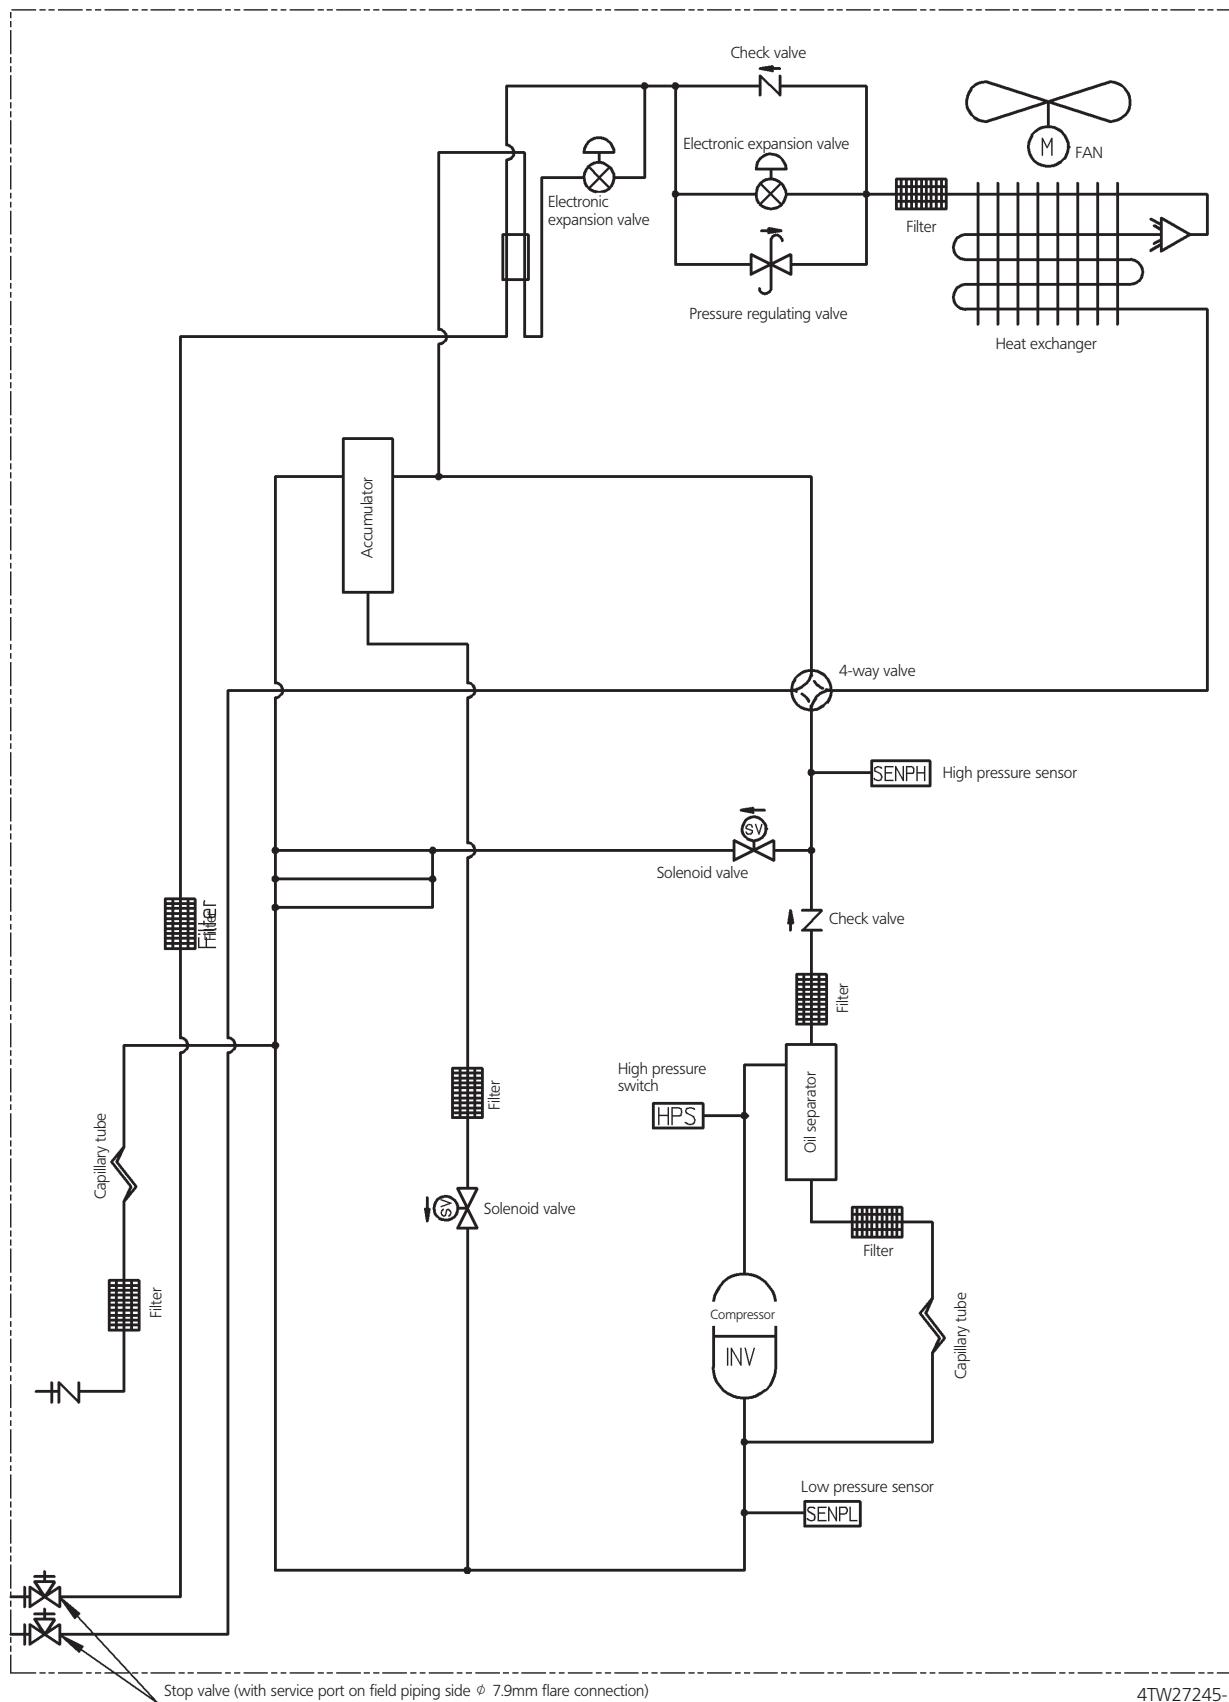


4TW27245-1

## 8 Piping diagrams

### 8 - 1 Piping Diagrams

ERQ250AW1

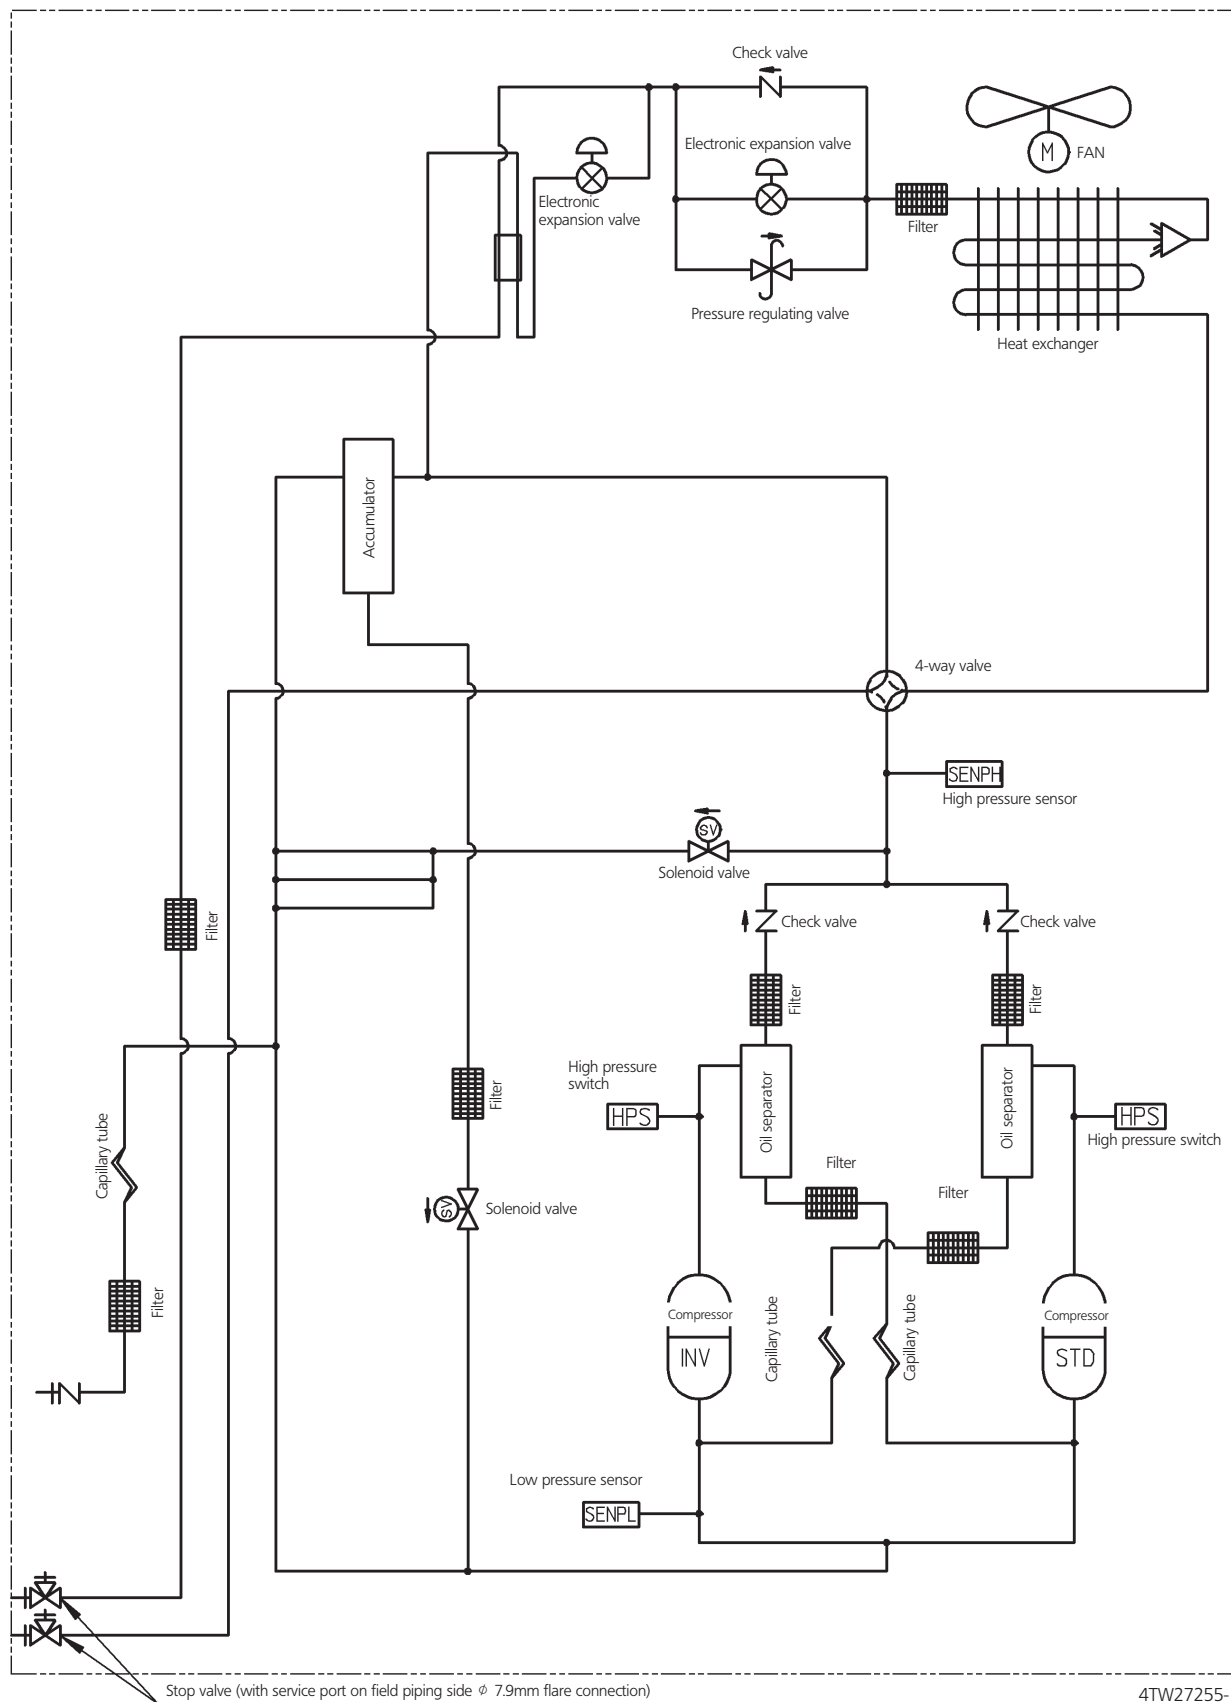


4TW27255-1

# 9 Wiring diagrams

## 9 - 1 Wiring Diagrams - Single Phase

### ERQ125AW1

- A1P : Printed circuit board (Main)
- A2P : Printed circuit board (Noise filter)
- A3P : Printed circuit board (inverter)
- A4P : Printed circuit board (Fan)
- A5P : Printed circuit board (ABC I/P)
- BS1~BS5 : Push button switch (Mode, set, return, test, reset)
- C1 : Capacitor
- C63,C66 : Dip switch
- DS1,DS2 : Crankcase heater
- E1HC : Fuse (250V, 3A (3)) (A4P)
- F1U,F2U : Fuse (250V, 315A (3)) (A1P)
- F5U : Field fuse
- F400U : Pilotlamp (service monitor - orange)
- H1P~H8P : Prepare test — Flickering
- H2P : Multifunction detection — Light up
- HAP : Pilotlamp (service monitor - green)
- K1 : Magnetic relay
- K2 : Magnetic contactor(M1C)
- K3R : Magnetic relay (Y1S)
- K4R : Magnetic relay (Y2S)
- K5R : Magnetic relay (Y3S)
- K7R : Magnetic relay (E1HC)
- K11R : Magnetic relay (Y4S)
- L1R : Reactor
- M1C : Motor (compressor)
- M1F : Motor (fan)
- P5 : Switching power supply (A1P/A3P)
- Q1BP : Phase reversal detect circuit
- Q1DI : Earth leakage breaker
- R10 : Resistor (Current sensor) (A4P)
- R50,R59 : Resistor
- R95 : Resistor (current limiting)
- R11 : Thermistor (air) (A1P)
- R1T : Thermistor (Fin) (A3P)
- R2T : Thermistor (Suction)
- R3T : Thermistor (discharge pipe) (M1C)
- R4T : Thermistor (Heat exch. deicer)
- R5T : Thermistor (liquid pipe)
- R6T : Thermistor (Accumulator)
- S1NPH : Pressure sensor (High)
- S1NPL : Pressure sensor (Low)
- S1PH : Pressure switch (High)
- S01 : Safety devices input
- V1R : Power module (A4P)
- V1R,V2R : Power module (A3P)
- X1A,X2A : Connector (M1F)
- X1M : Terminal strip (Power supply)
- X1M : Terminal strip (Control) (A1P)
- X1M : Terminal strip (A5P)
- Y1E : Electronic expansion valve (Main)
- Y1S : Solenoid valve (Hot gas)
- Y2S : Solenoid valve (oil return)
- Y3S : Solenoid valve (4-way valve)
- Y4S : Solenoid valve (injection)
- Z1C~Z5C : Noise filter (ferrite core)
- Z1F : Noise filter (with surge absorber)

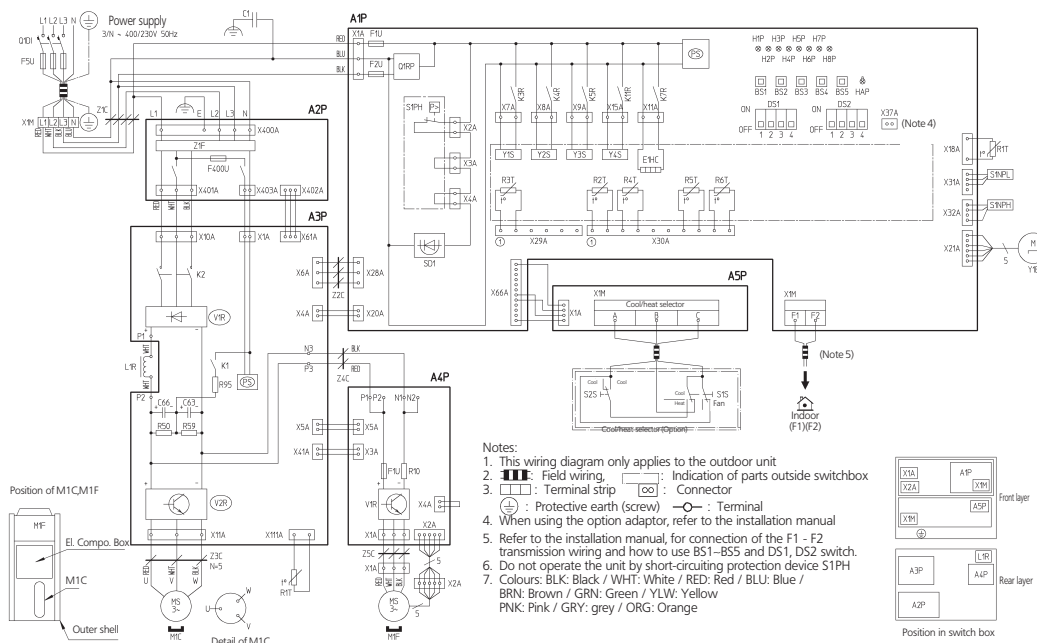


2TW32036-1

## 9 Wiring diagrams

### 9 - 1 Wiring Diagrams - Single Phase

ERQ200AW1

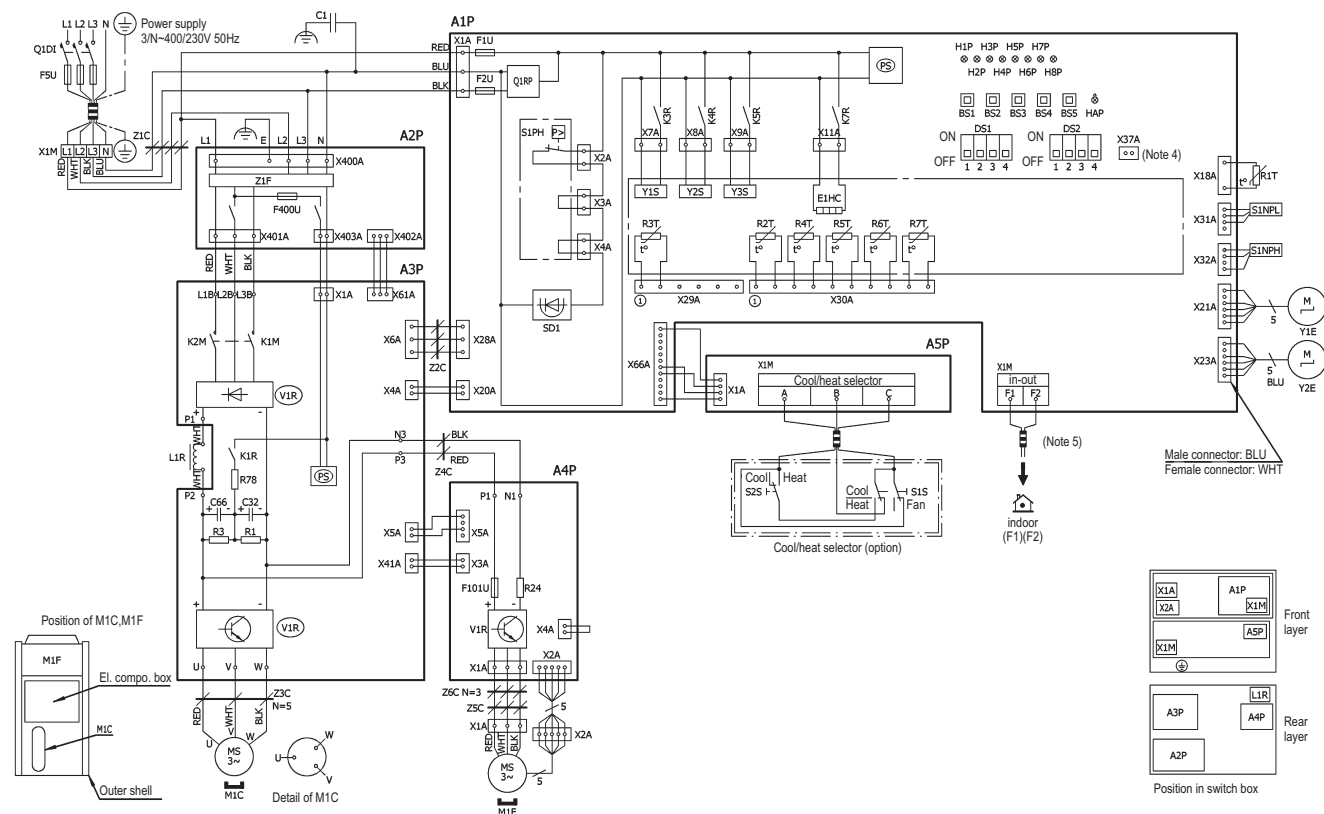

A1P~A5P		R1,R3	
Printed circuit board		Resistor	
A1P: Main	A4P: Fan	R78	Resistor (current limiting)
A2P: Noise Filter	A5P: ABC I/P		
A3P: Inverter			
BS1~BS5	Push Button Switch (mode, set, return, test, reset)	R1T~R7T	Thermistor
C1	Capacitor	R1T: Air (A1P)	R4T: Heat exch. deicer
C32,C66	Capacitor	R2T: Suction	R5T: Heat exch. outlet
DS1,DS2	DIP switch	R3T: M1C discharge	R6T: Liquid pipe
E1HC	Crankcase heater	R7T: Accumulator	
F101U	Fuse (A4P)		
F1U,F2U	Fuse (250V, 3.15A) (A1P)		
F5U	Field fuse		
F400U	Fuse (250V, 6.3A) (A2P)		
H1P~H8P	Pilotlamp (Service monitor - orange)		
	[H2P] Prepare, test - - - - - flickering		
	Malfunction detection - - light up		
HAP	Pilotlamp (service monitor - green)		
K1R	Magnetic relay		
K1M,K2M	Magnetic contactor (M1C)		
K3R~K7R	K3R: Y1S	K5R: Y3S	
	K4R: Y2S	K7R: E1HC	
L1R	Reactor		
M1C	Motor (compressor)		
M1F	Motor (fan)		
PS	Switching power supply (A1P,A3P)		
Q1RP	Phase reversal detect circuit		
Q1DI	Earth leakage breaker		
R24	Resistor (current sensor) (A4P)		
		X1A,X2A	Connector (M1F)
		X1M	Terminal strip (power supply)
		X1M	Terminal strip (control)(A1P)
		X1M	Terminal strip(A5P)
		Y1E	Electronic expansion valve (main)
		Y2E	Electronic expansion valve (subcool)
			Solenoid valve
		Y1S~Y3S	Y1S: Hot gas
			Y3S: 4 way valve
			Y2S: Oil return
		Z1C~6C	Noise filter (ferrite core)
		Z1F	Noise filter (with surge absorber)
			Cool/heat selector
		S1S	Selector switch (fan/cool - heat)
		S2S	Selector switch (cool - heat)

#### NOTES


- This wiring diagram only applies to the outdoor unit.
- - - - - : field wiring, [ ] : indication of parts outside switchbox.
- [ ] : terminal strip, [ ] : connector, ○ : terminal, ⊕ : protective earth (screw).
- When using the option adapter, refer to the installation manual.
- Refer to the installation manual, for connection wiring to indoor-outdoor transmission F1 - F2 and on how to use BS1~BS5 and DS1, DS2 switch.
- Do not operate the unit by short-circuiting protection device S1PH.
- BLK: black, RED: red, BLU: blue, WHT: white, PNK: pink, YLW: yellow, BRN: brown, GRY: grey, GRN: green, ORG: orange.



# 9 Wiring diagrams

## 9 - 1 Wiring Diagrams - Single Phase

ERQ250AW1

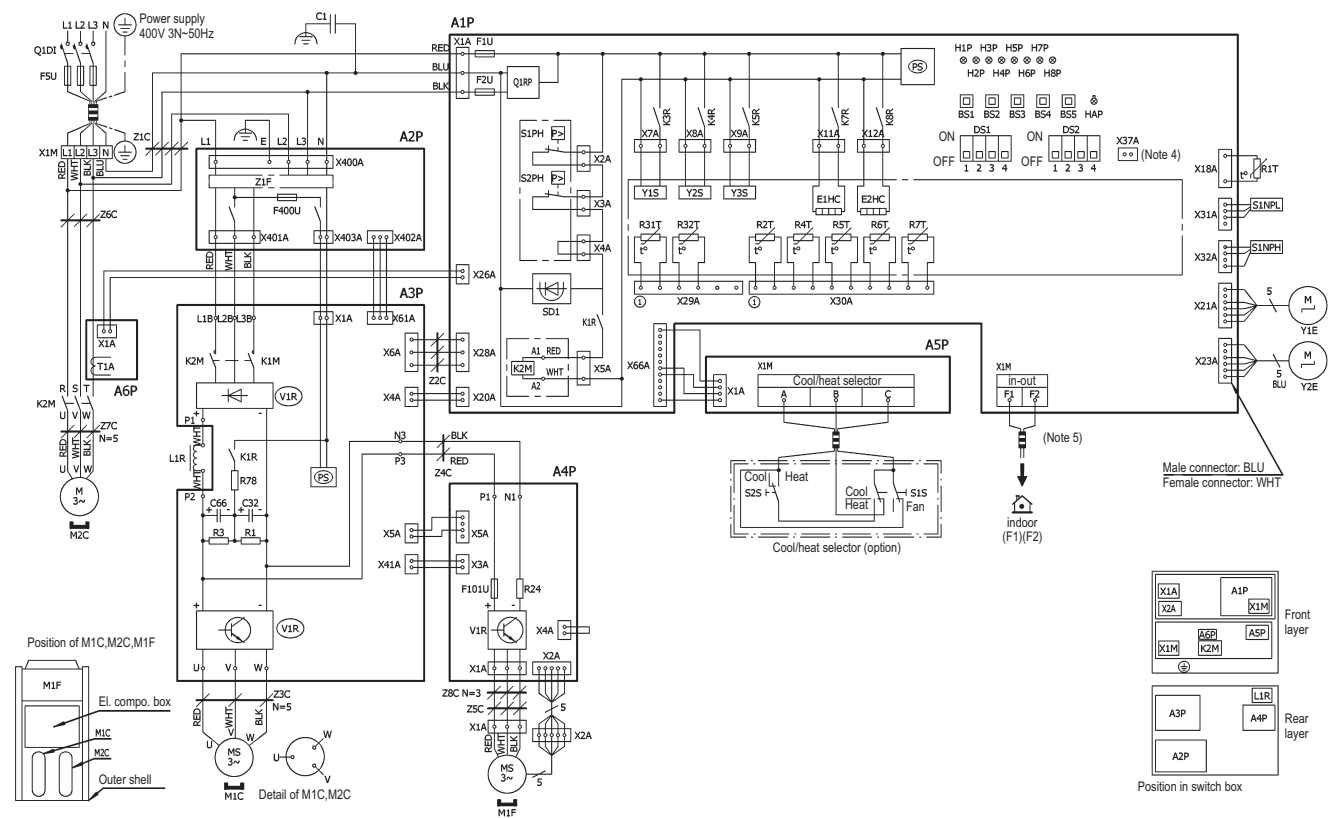

A1P~A6P		Q1DI	
Printed circuit board		Earth leakage breaker	
A1P: Main	A4P: Fan	R24	Resistor (current sensor) (A4P)
A2P: Noise Filter	A5P: ABC I/P	R1, R3	Resistor
A3P: Inverter	A6P: Current Sensor	R78	Resistor (current limiting)
BS1~BS5	Push Button Switch (mode, set, return, test, reset)	Thermistor	
C1	Capacitor	R1T~R7T	R1T: Air (A1P) R4T: Heat exch. deicer
C32, C66	Capacitor	R31T, R32T	R2T: Suction R5T: Heat exch. outlet
DS1, DS2	DIP switch		R31T: M1C discharge R6T: Liquid pipe
E1HC, E2HC	Crankcase heater		R32T: M2C discharge R7T: Accumulator
F101U	Fuse (A4P)	S1NPH	Pressure sensor (high)
F1U, F2U	Fuse (250V, 3.15A) (A1P)	S1NPL	Pressure sensor (low)
F5U	Field fuse	S1PH, S2PH	Pressure switch (high)
F400U	Fuse (250V, 6.3A) (A2P)	T1A	Current sensor (A6P)
H1P~H8P	Pilotlamp (Service monitor - orange)	SD1	Safety devices input
[H2P] Prepare, test - - - - - flickering		V1R	Power module (A4P)
Malfunction detection - - - light up		V1R	Power module (A3P)
HAP	Pilotlamp (service monitor - green)	X1A, X2A	Connector (M1F)
K1R	Magnetic relay	X1M	Terminal strip (power supply)
K1M, K2M	Magnetic contactor (M1C)	X1M	Terminal strip (control) (A1P)
K2M	Magnetic contactor (M2C)	X1M	Terminal strip (A5P)
K1R	Magnetic relays (K2M)	Y1E	Electronic expansion valve (main)
K3R~K8R	K3R: Y1S K4R: Y2S K5R: Y3S	Y2E	Electronic expansion valve (subcool)
	K7R: E1HC K8R: E2HC	Y1S~Y3S	Solenoid valve
L1R	Reactor	Y1S: Hot gas	Y3S: 4 way valve
M1C, M2C	Motor (compressor)	Y2S: Oil return	
M1F	Motor (fan)	Z1C~Z8C	Noise filter (ferrite core)
PS	Switching power supply (A1P, A3P)	Z1F	Noise filter (with surge absorber)
Q1RP	Phase reversal detect circuit	Cool/heat selector	
		S1S	Selector switch (fan/cool - heat)
		S2S	Selector switch (cool - heat)


### NOTES

- This wiring diagram only applies to the outdoor unit.
- ( )-- : field wiring.
- ( ) : terminal strip, ( ) : connector, ( ) : terminal, ( ) : protective earth (screw).
- When using the option adapter, refer to the installation manual.
- Refer to the installation manual, for connection wiring to indoor-outdoor transmission F1 - F2 and on how to use BS1~BS5 and DS1, DS2 switch.
- Do not operate the unit by short-circuiting protection device S1PH.
- BLK: black, RED: red, BLU: blue, WHT: white, PNK: pink, YLW: yellow, BRN: brown, GRY: grey, GRN: green, ORG: orange.

## 10 External connection diagrams

### 10 - 1 External Connection Diagrams

#### ERQ-AW1

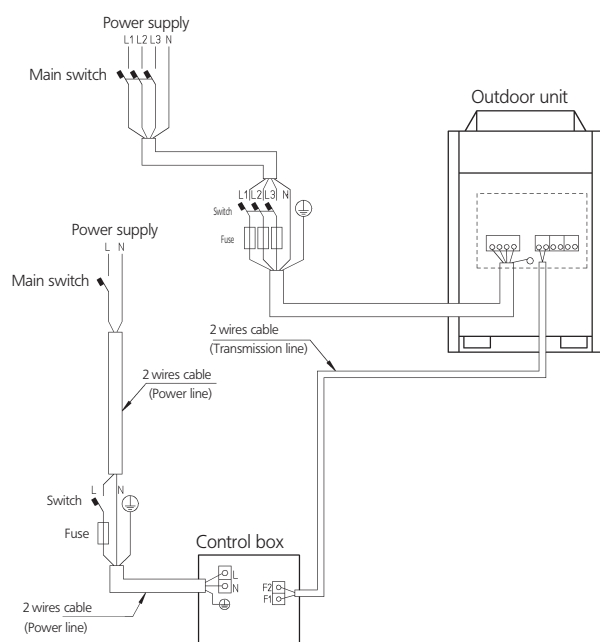


- 1 All wiring, components and materials to be produced on the site must comply with the applicable local and national codes.
- 2 Use copper conductors only.
- 3 For more details, see wiring diagram.
- 4 Install a circuit breaker for safety.
- 5 All field wiring and components must be installed by a licensed electrician.
- 6 All field wiring and components must be provided by a licensed electrician and must comply with the relevant local and national codes.
- 7 Wiring shown are general points-of-connection guides only and are not intended for or to include all details for a specific installation.
- 8 Be sure to install the switch and the fuse to the power line of each equipment.
- 9 Install the main switch that can interrupt all power sources in an integrated manner because this system consists of the equipment utilizing the multiple power sources.
- 10 If there exists the possibility of reversed phase, lose phase, momentary blackout or the power goes on and off while the product is operating, attach a reversed phase protection circuit locally.
- 11 For detailed control box side connection, see control box manual and wiring diagram.

3TW27809-1


# 11 Sound data

## 11 - 1 Sound Power Spectrum

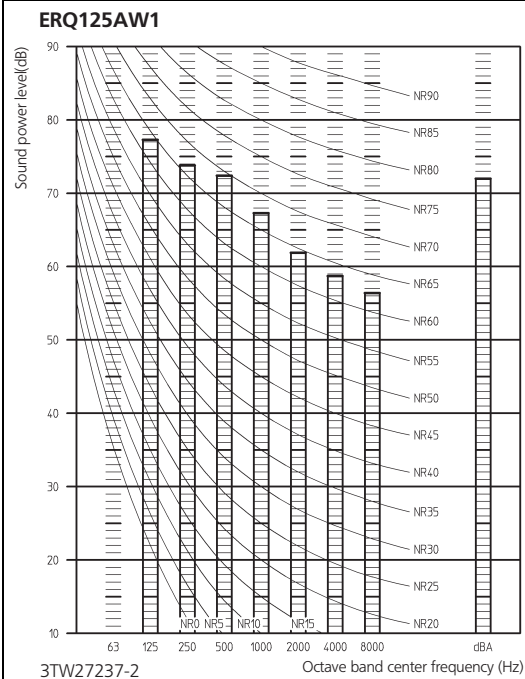


**NOTES**

- 1 dBA = A-weighted sound power level (A-scale according to IEC)
- 2 Reference acoustic intensity 0dB = 10E-6μW/m<sup>2</sup>
- 3 Measured according to ISO 3744

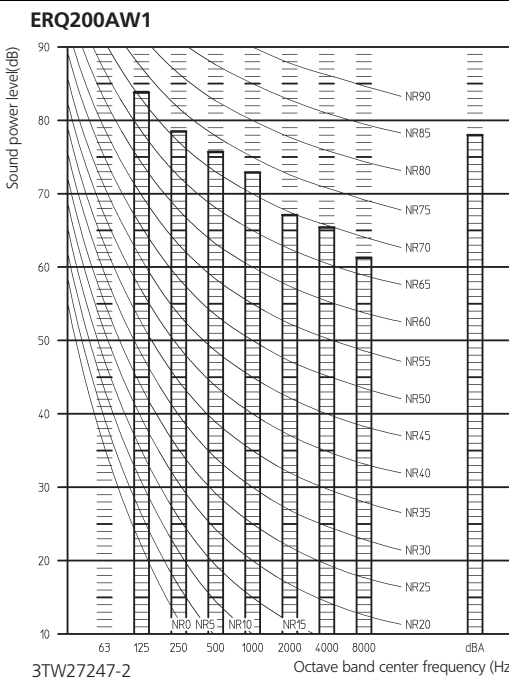

**NOTES**

- 1 dBA = A-weighted sound power level (A-scale according to IEC)
- 2 Reference acoustic intensity 0dB = 10E-6μW/m<sup>2</sup>
- 3 Measured according to ISO 3744

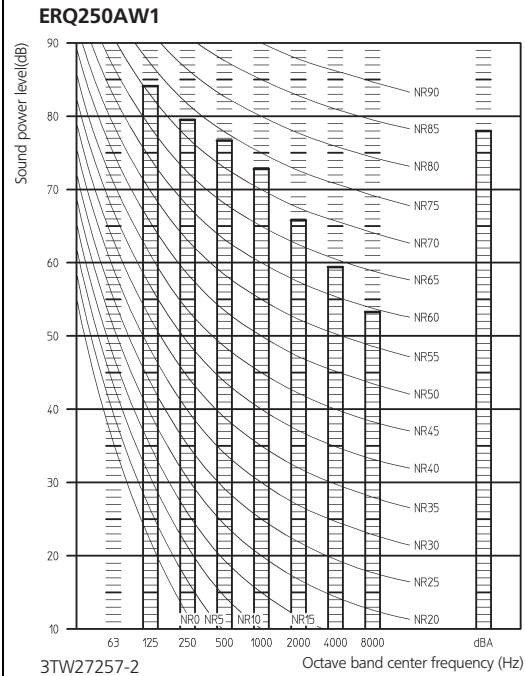

**NOTES**


- 1 dBA = A-weighted sound power level (A-scale according to IEC)
- 2 Reference acoustic intensity 0dB = 10E-6μW/m<sup>2</sup>
- 3 Measured according to ISO 3744

# 11 Sound data

## 11 - 2 Sound Pressure Spectrum

11

ERQ125AW1

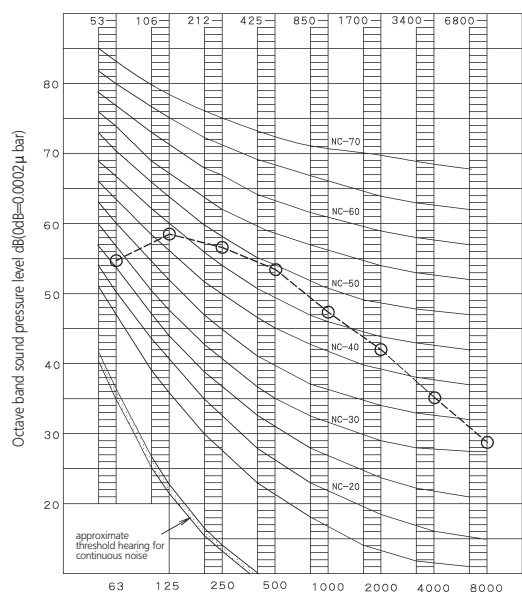


4D052394B

Octave band center frequency (Hz)


### NOTES

- 1 The operating sound is measured in anechoic chamber, if it is measured under the actual installation conditions, it is normally over the set value due to environmental noise and sound reflection.



Location of microphone

ERQ200AW1

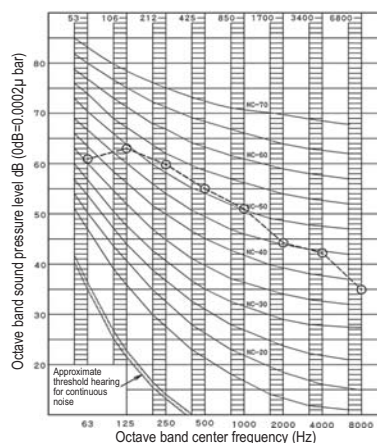


4D052395K


### NOTES

- 1 Over All (dB):  
(B. G. N is already rectified)
- 2 Operating conditions:
  - Power source Y1: 380-415V 50Hz
  - JIS standard
- 3 Measuring place: anechoic chamber (conversion value)
- 4 The operating sound is measured in anechoic chamber, if it is measured under the actual installation conditions, it is normally over the set value due to environmental noise and sound reflection.
- 5 Location of microphone.

Scale	50Hz
A	57.0
C	66.5



ERQ250AW1

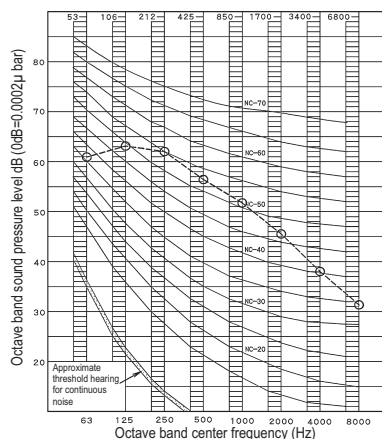


4D052396L

### NOTES

- 1 Over All (dB):  
(B. G. N is already rectified)
- 2 Operating conditions:
  - Power source Y1: 380-415V 50Hz
  - JIS standard
- 3 Measuring place: anechoic chamber (conversion value)
- 4 The operating sound is measured in anechoic chamber, if it is measured under the actual installation conditions, it is normally over the set value due to environmental noise and sound reflection.
- 5 Location of microphone.

Scale	50Hz
A	58.0
C	67.0






# 12 Installation




## 12 - 1 Installation Method

### ERQ-AW1





For single unit installation



For installation in rows

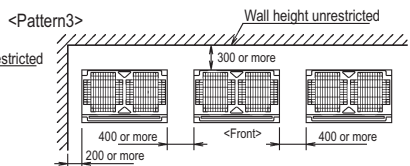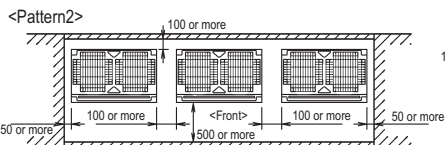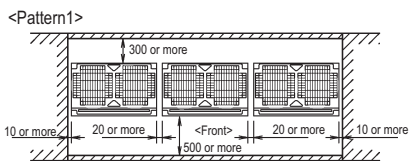


For centralized group layout

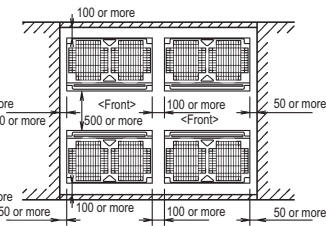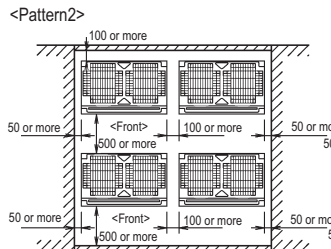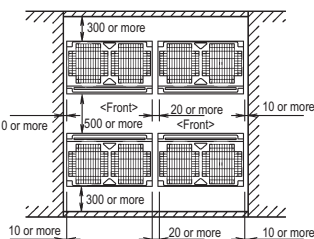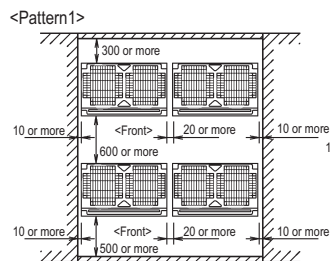

<Unit: mm>

### NOTES

- Heights of walls in case of Patterns 1 and 2:  
Front: 1500mm  
Suction side: 500mm  
Side: Height unrestricted  
Installation space to be shown in this drawing is based on the cooling operation at 35 degrees outdoor air temperature.  
When the design outdoor air temperature exceeds 35 degrees or the load exceeds maximum ability because of much generation load of heat in all outdoor units, take the suction side space more broadly than the space to be shown in this drawing.
- If the above wall heights are exceeded then h2/2 and h1/2 should be added to the front and suction side service space respectively as shown in the figure on the right.
- When installing the units most appropriate pattern should be selected from those shown above in order to obtain the best fit in the space available always bearing in mind the need to leave enough space for a person to pass between units and wall and for the air to circulate freely. (If more units are to be installed than are catered for in the above patterns your layout should take account of the possibility of short circuits.)
- The units should be installed to leave sufficient space at the front for the on site refrigerant piping work to be carried out comfortably.






3D051451V

## 12 Installation

### 12 - 2 Fixation and Foundation of Units

12

#### ERQ-AW1

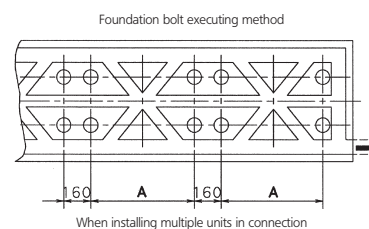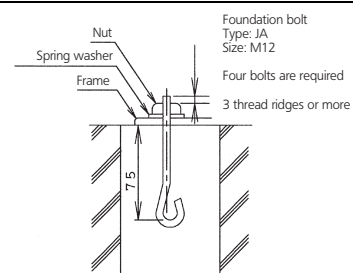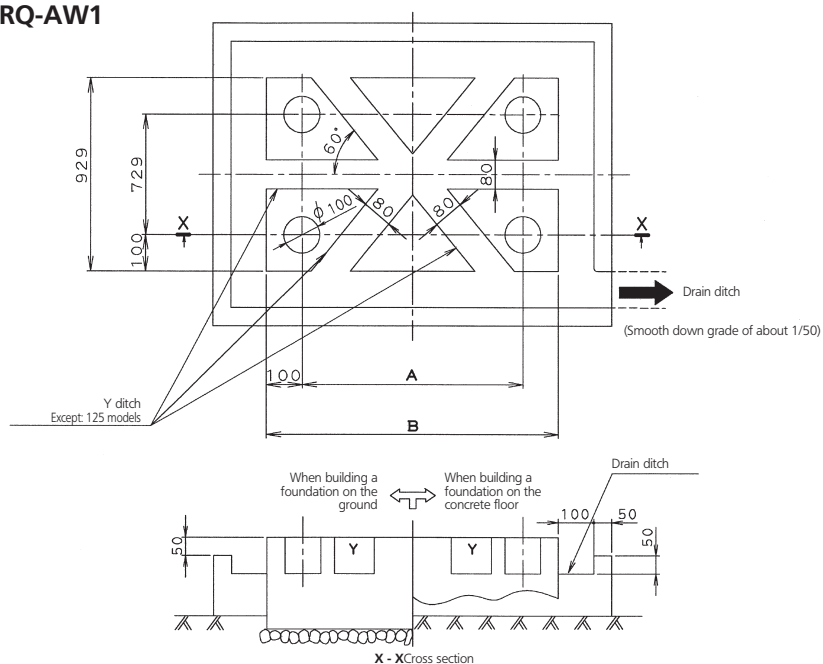

Model	A	B
ERQ125A7W18	497	697
ERQ200A7W18	792	992
ERQ250A7W18	792	992

#### NOTES



- 1 The proportions of cement: sand: gravel for the concrete shall be 1:2:4, and the reinforcement bars that their diameter are 10mm, (approx. 300mm intervals) shall be placed.
- 2 The surface shall be finished with mortar. The corner edges shall be chamfered.
- 3 When the foundation is built on a concrete floor, rubble is not necessary. However, the surface of the section on which the foundation is built shall have rough finish.
- 4 A drain ditch shall be made around the foundation to thoroughly drain water from the equipment installation area.
- 5 When installing the equipment on a roof, the floor strength shall be checked, and water-proofing measures shall be taken.
- 6 Y Ditch is not necessary for 125 models.

3TW32039-6

## 13 Operation range

### 13 - 1 Operation Range

#### ERQ-AW1

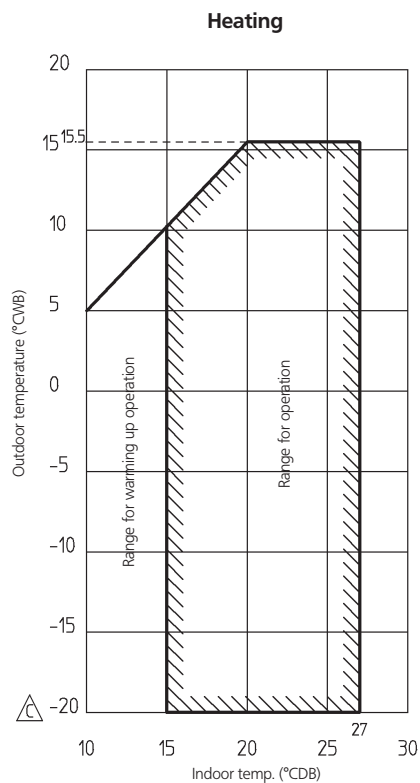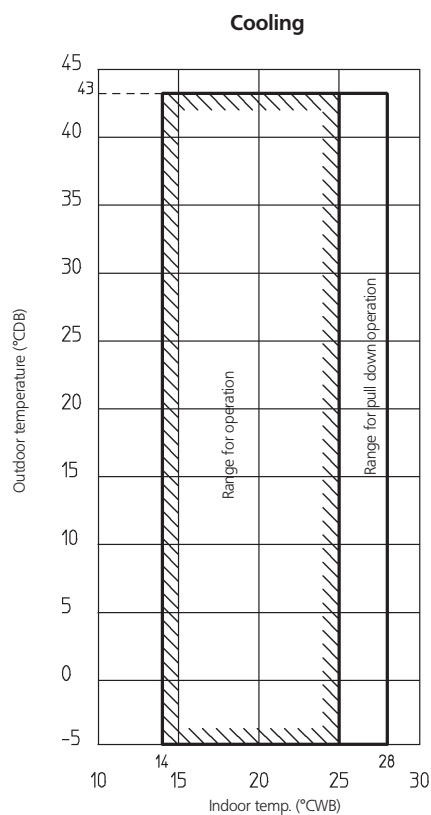

#### NOTES

1 These figures assume the following operating conditions.

Indoor and outdoor units:

- Equivalent piping length 7.5m
- Level difference 0m


2 Depending on operation and installation conditions, the indoor unit can change over to freeze-up operation (indoor de-icing).

3 To reduce the freeze-up operation (indoor de-icing) frequency it is recommended to install the outdoor unit in a location not exposed to wind.

4TW25797-3C







These products are not within the scope of the Eurovent certification program

The present leaflet is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V.. Daikin Europe N.V. has compiled the content of this leaflet to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this leaflet. All content is copyrighted by Daikin Europe N.V.

BARCODE

Daikin products are distributed by:

